

D

C

B

A

D

C




B

A

120VAC
6 CIRCUIT
20AMPS MAX

PINOUT: P19-01
1 = H CKT 1
2 = N CKT 1
3 = H CKT 2
4 = N CKT 2
5 = H CKT 3
6 = N CKT 3
7 = H CKT 4
8 = N CKT 4
9 = H CKT 5
10 = N CKT 5
11 = H CKT 6
12 = N CKT 6
13-19 = GROUND RING

PNL1
PNL2
PNL3

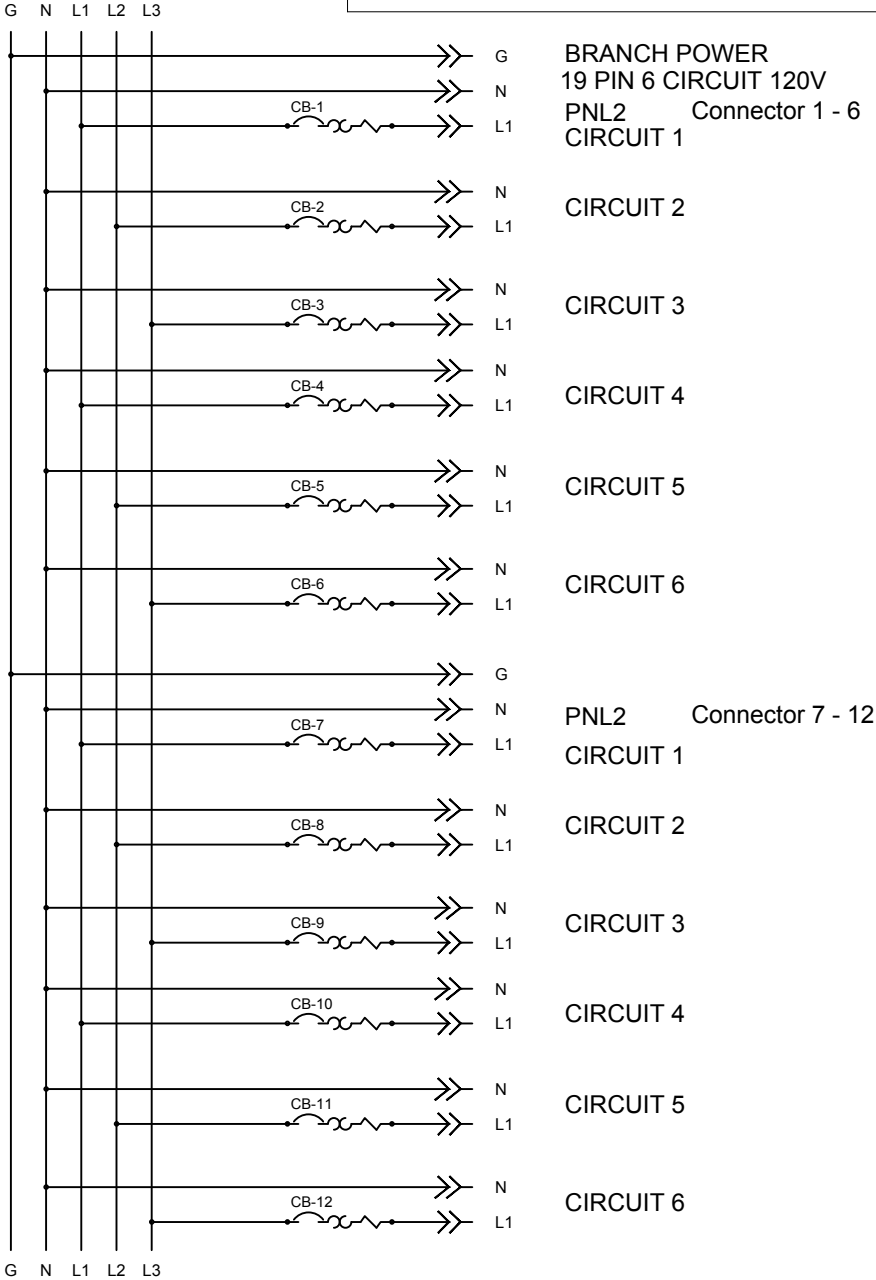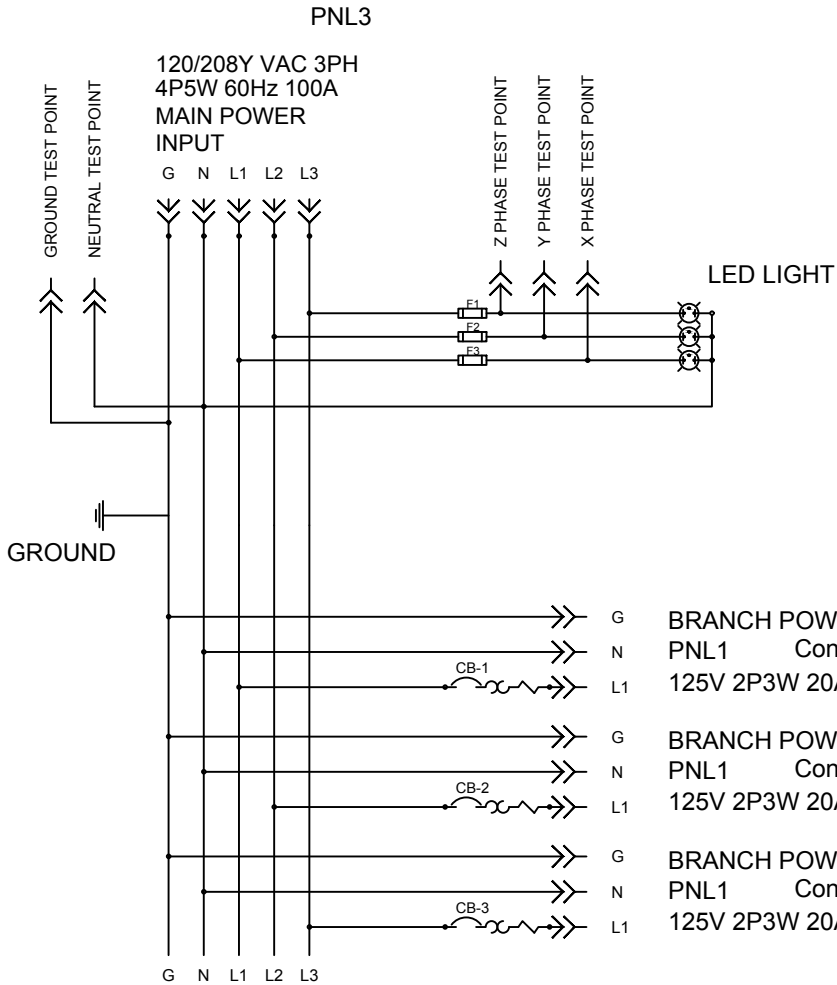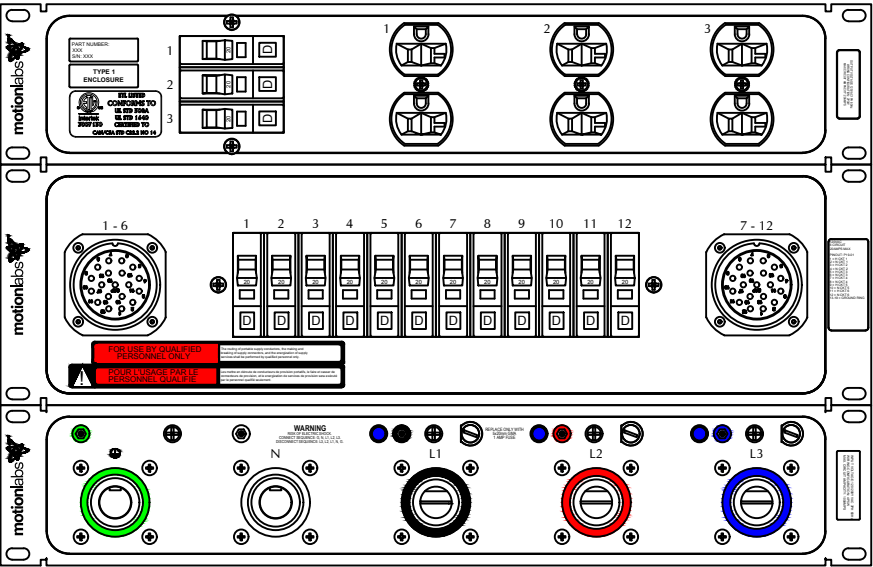

REV	DESCRIPTION	Date	APPROVED
B	WAS 1302-JRLight-122117. JK 3/5/18	3/5/18	DC

motionlaboratories

520 FURNACE DOCK ROAD
CORTLANDT MANOR, NY 10567
(814) 796-6677

TITLE:
SCHEMATIC

SIZE D	Checked By: DC	DWG NO. 1300-000-07-1-02	REV B
Drawn By: SB	Sheet 1 OF 1		