


D

C


B

A

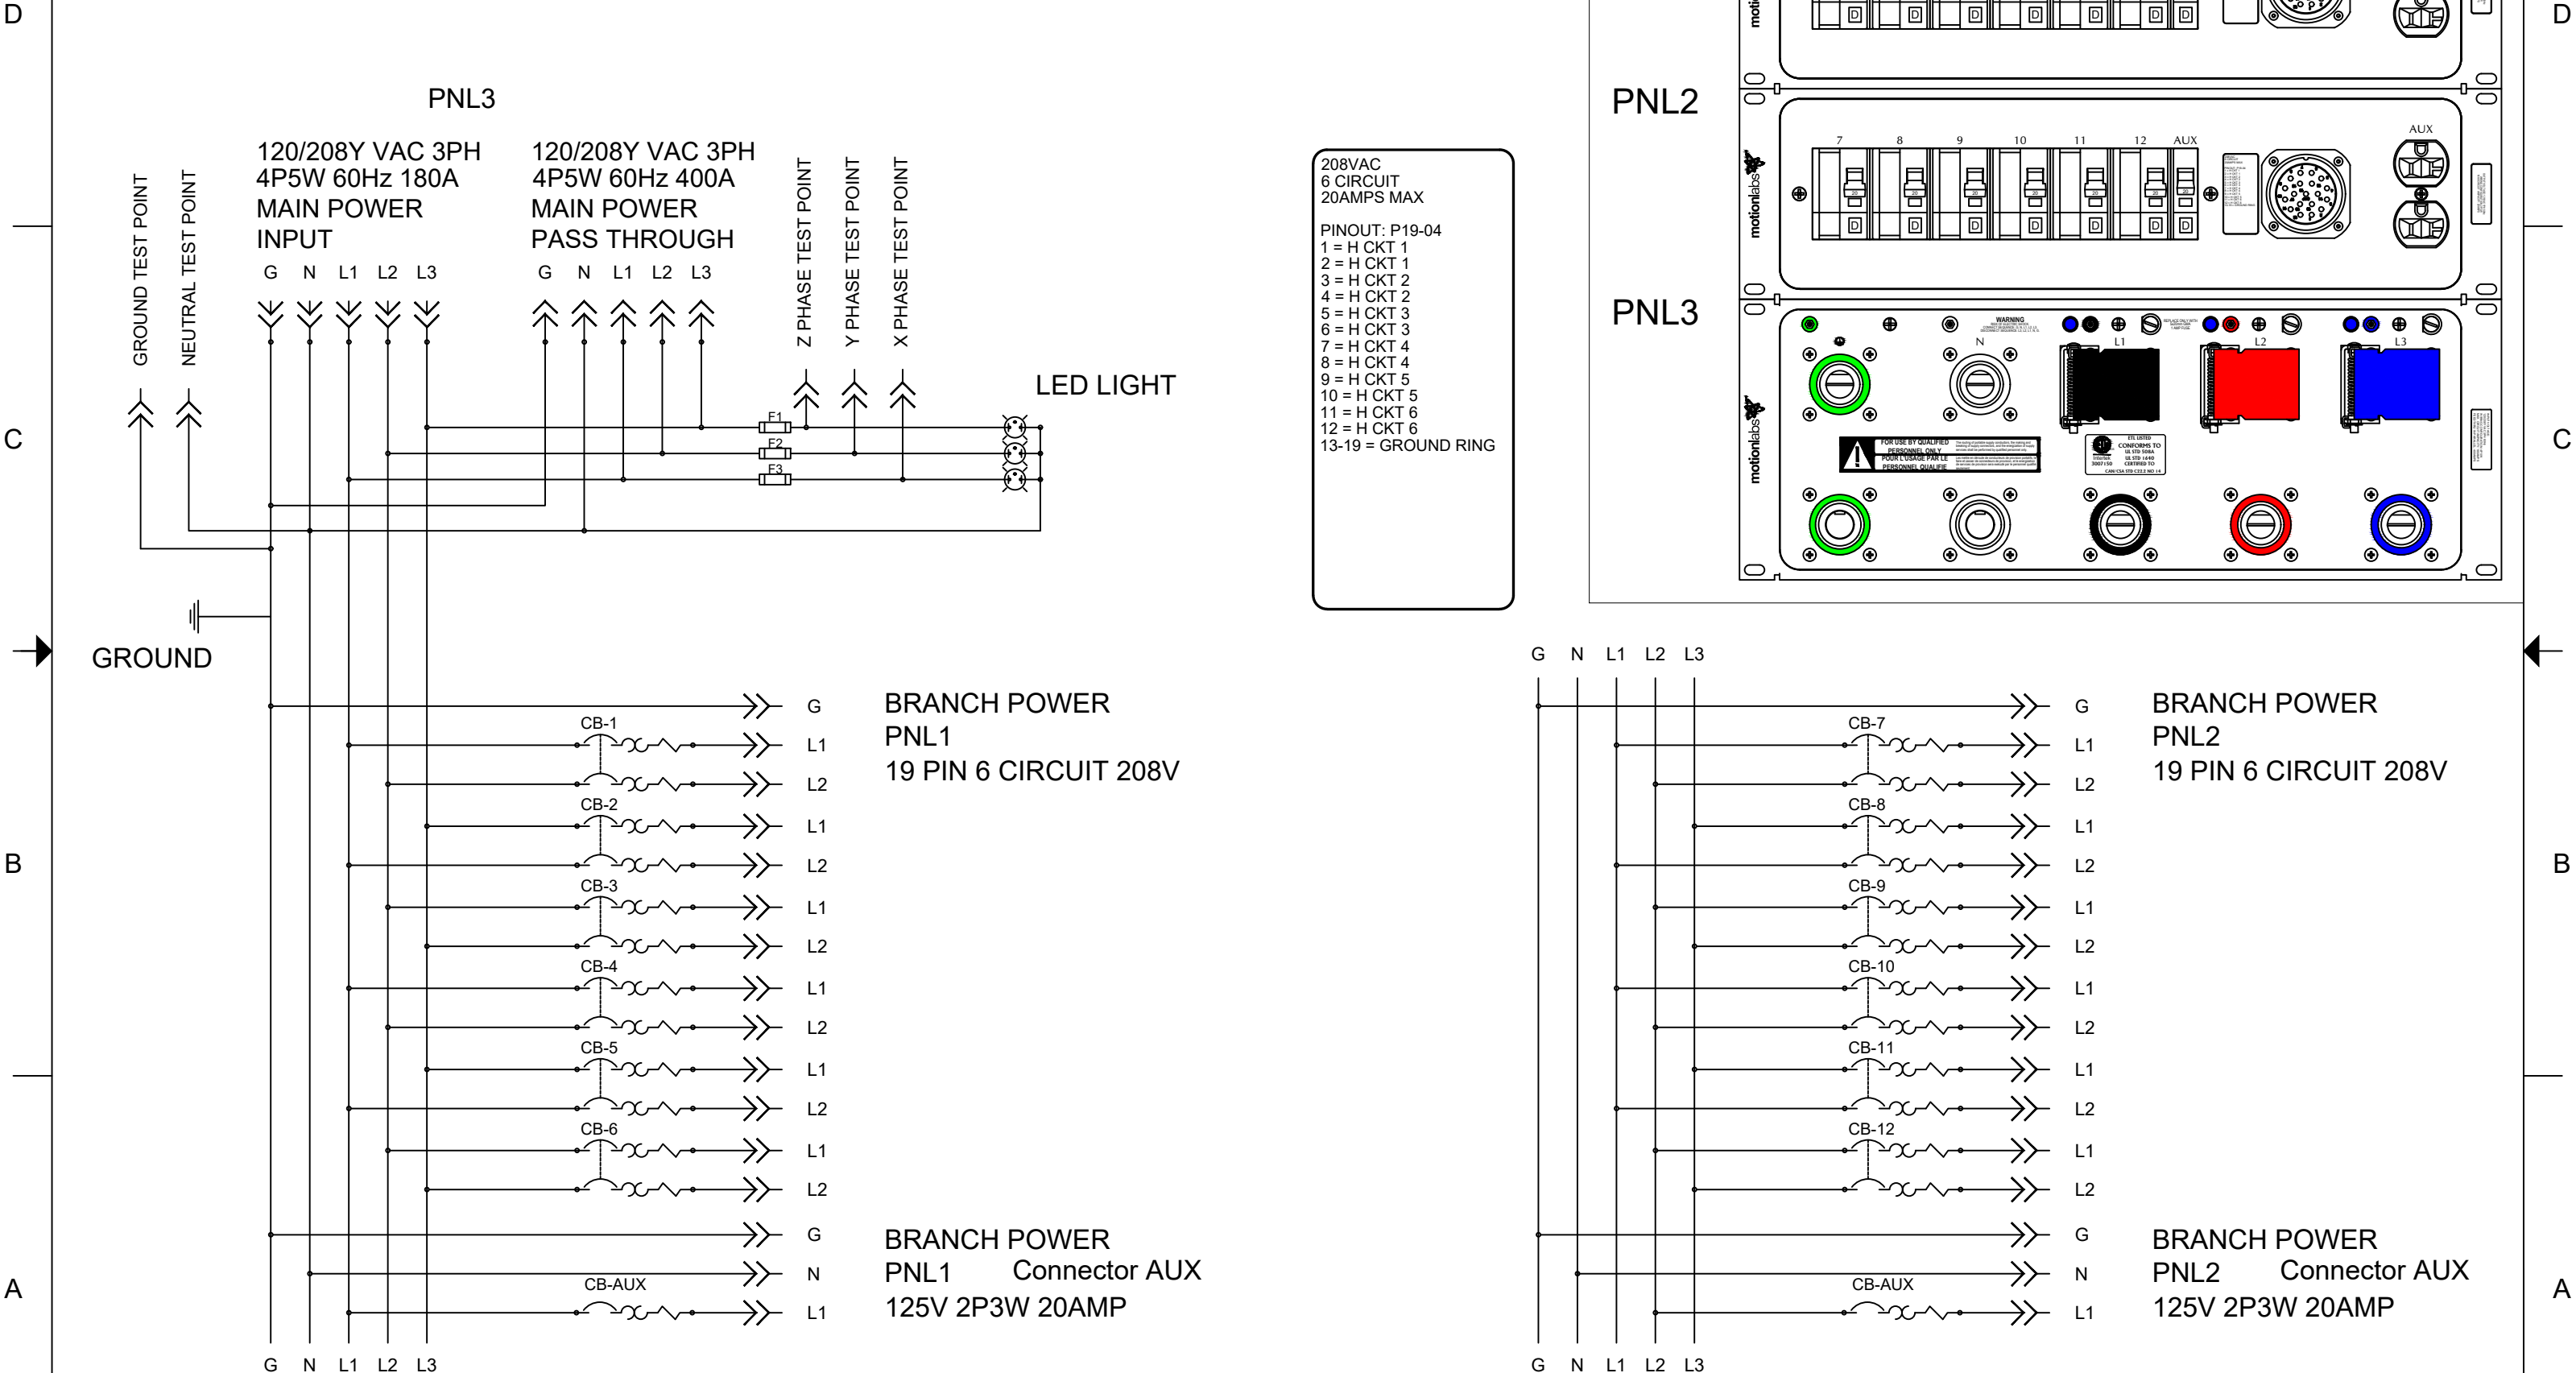

208VAC
6 CIRCUIT
20AMPS MAX

PINOUT: P19-04
1 = H CKT 1
2 = H CKT 1
3 = H CKT 2
4 = H CKT 2
5 = H CKT 3
6 = H CKT 3
7 = H CKT 4
8 = H CKT 4
9 = H CKT 5
10 = H CKT 5
11 = H CKT 6
12 = H CKT 6
13-19 = GROUND RING

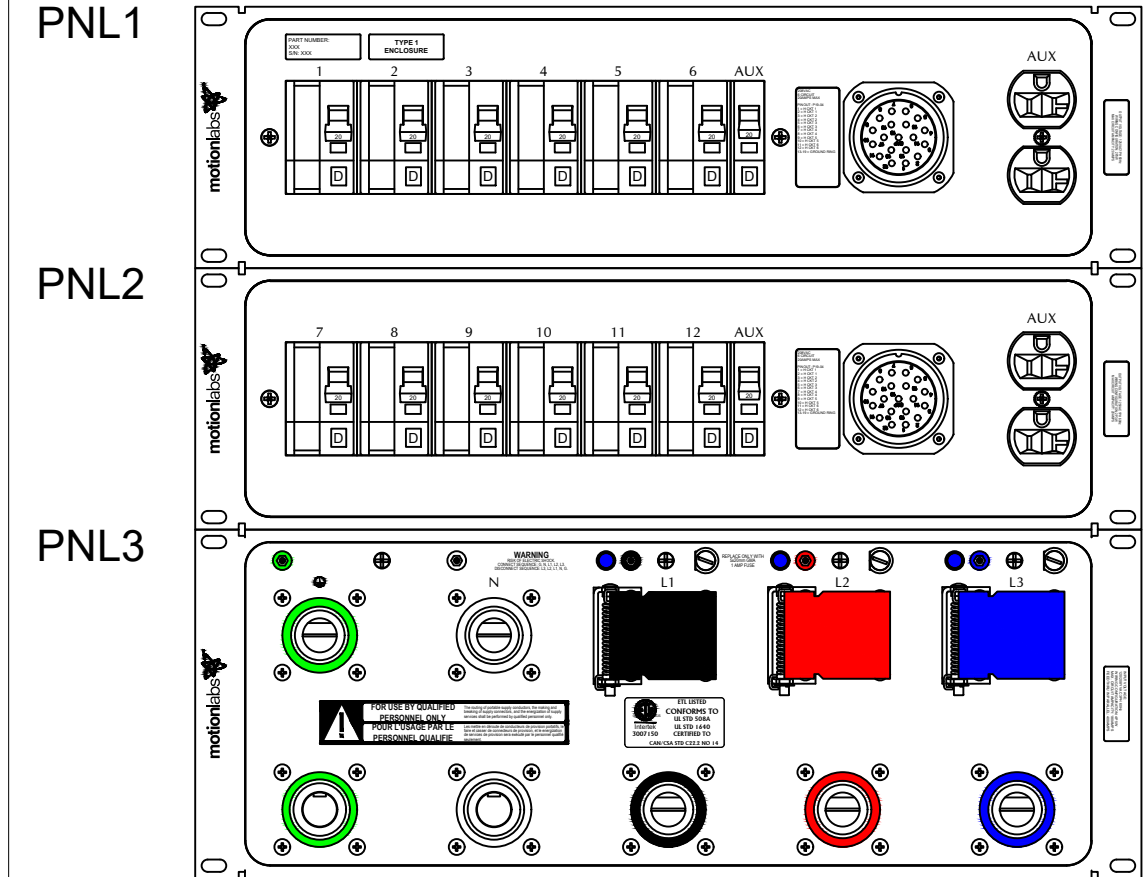

D

C

B

A

REV	DESCRIPTION	Date	APPROVED
B	B-01-352-2010 WAS B-01-352-2001. SB 8/2/18	8/3/18	JK

 520 FURNACE DOCK ROAD CORTLANDT MANOR, NY 10567 (514) 786-8677	TITLE: SCHEMATIC	SIZE D	Checked By: JC	DWG NO. 1300-000-10-1-01	REV B
		Drawn By: JK			Sheet 1 OF 1