
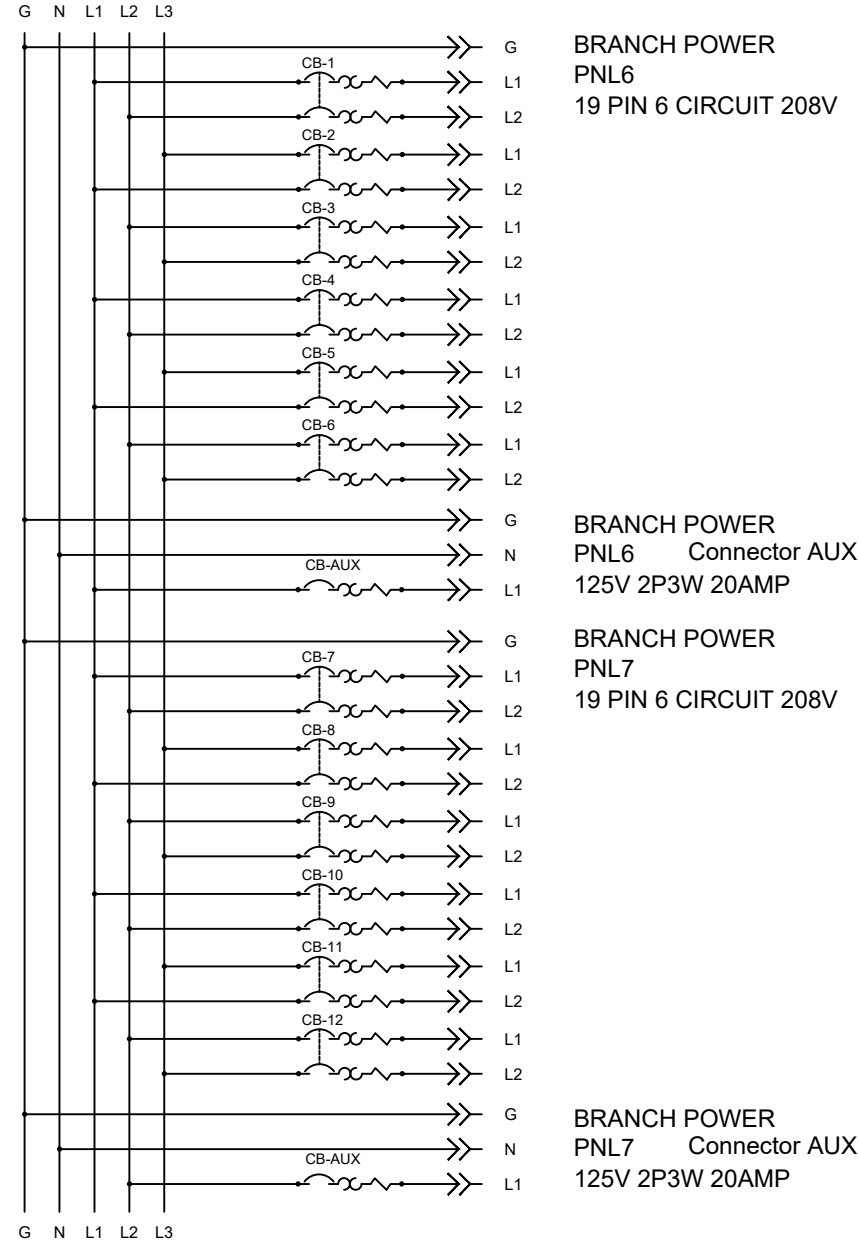
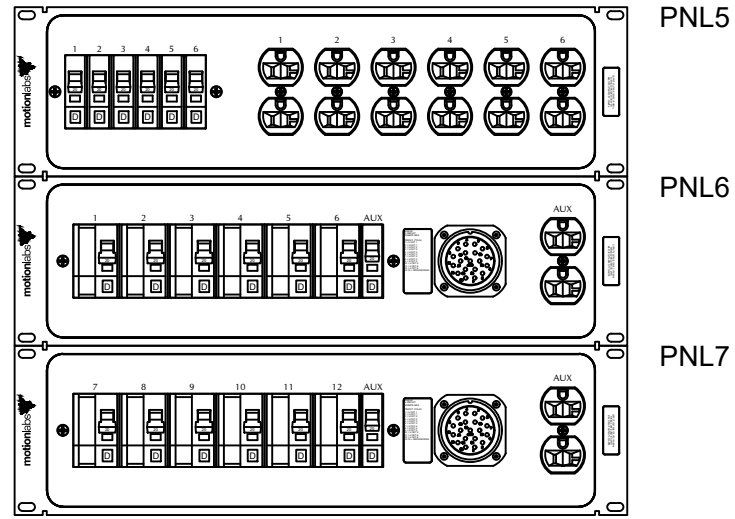
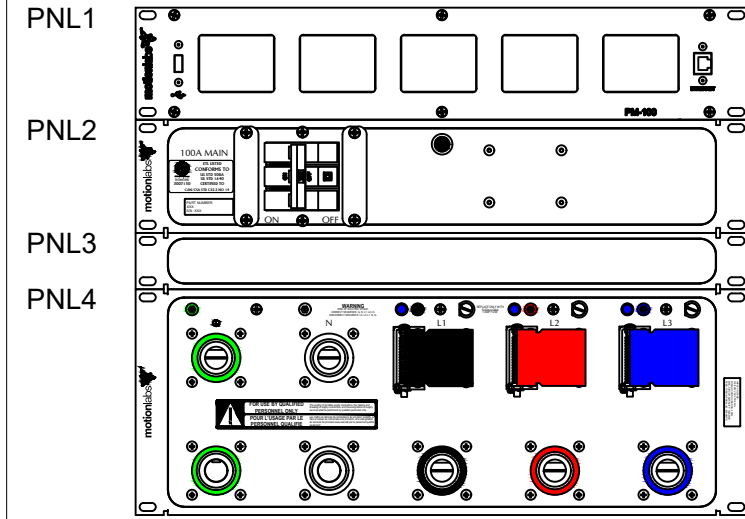


D

C

B

A

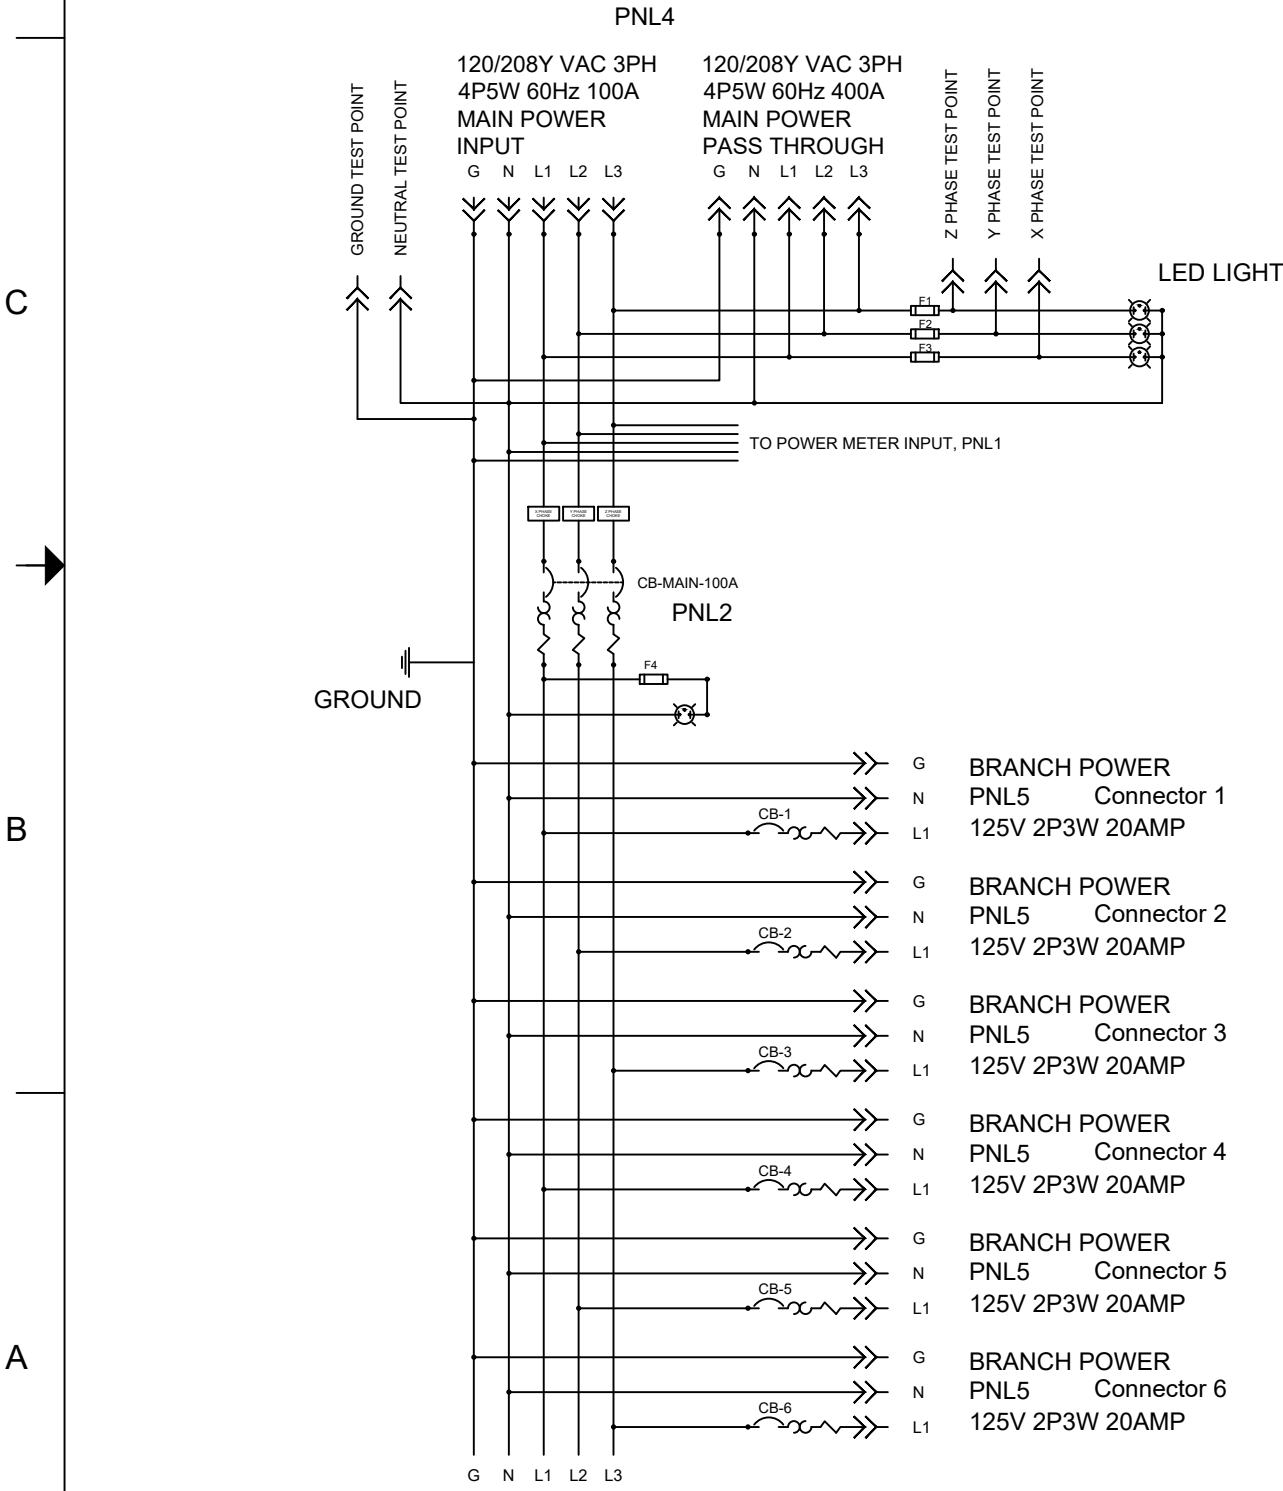

208VAC
6 CIRCUIT
20AMPS MAX

PINOUT: P19-04
1 = H CKT 1
2 = H CKT 1
3 = H CKT 2
4 = H CKT 2
5 = H CKT 3
6 = H CKT 3
7 = H CKT 4
8 = H CKT 4
9 = H CKT 5
10 = H CKT 5
11 = H CKT 6
12 = H CKT 6
13-19 = GROUND RING

REV	DESCRIPTION	Date	APPROVED
C	REVISED PER ECN 100. PART # WAS 1300-Barbizon-032706. SB 8/6/18	8/6/18	JK

 520 FURNACE DOCK ROAD CORTLANDT MANOR, NY 10567 (914) 786-8677	TITLE: SCHEMATIC	SIZE D	Checked By: PH	DWG NO. 1300-100A-09-2-20	REV C
	Drawn By: JC	Sheet 1 OF 1			