


D

C

B

A




120VAC 6 CIRCUIT 20AMPS MAX	3 = H CKT 2 4 = N CKT 2 5 = H CKT 3 6 = N CKT 3 7 = H CKT 4 8 = N CKT 4	9 = H CKT 5 10 = N CKT 5 11 = H CKT 6 12 = N CKT 6 13-19 = GROUND RING
PINOUT: P19-01 1 = H CKT 1 2 = N CKT 1	3 = H CKT 2 4 = H CKT 2 5 = H CKT 3 6 = H CKT 3 7 = H CKT 4 8 = H CKT 4	9 = H CKT 5 10 = H CKT 5 11 = H CKT 6 12 = H CKT 6 13-19 = GROUND RING

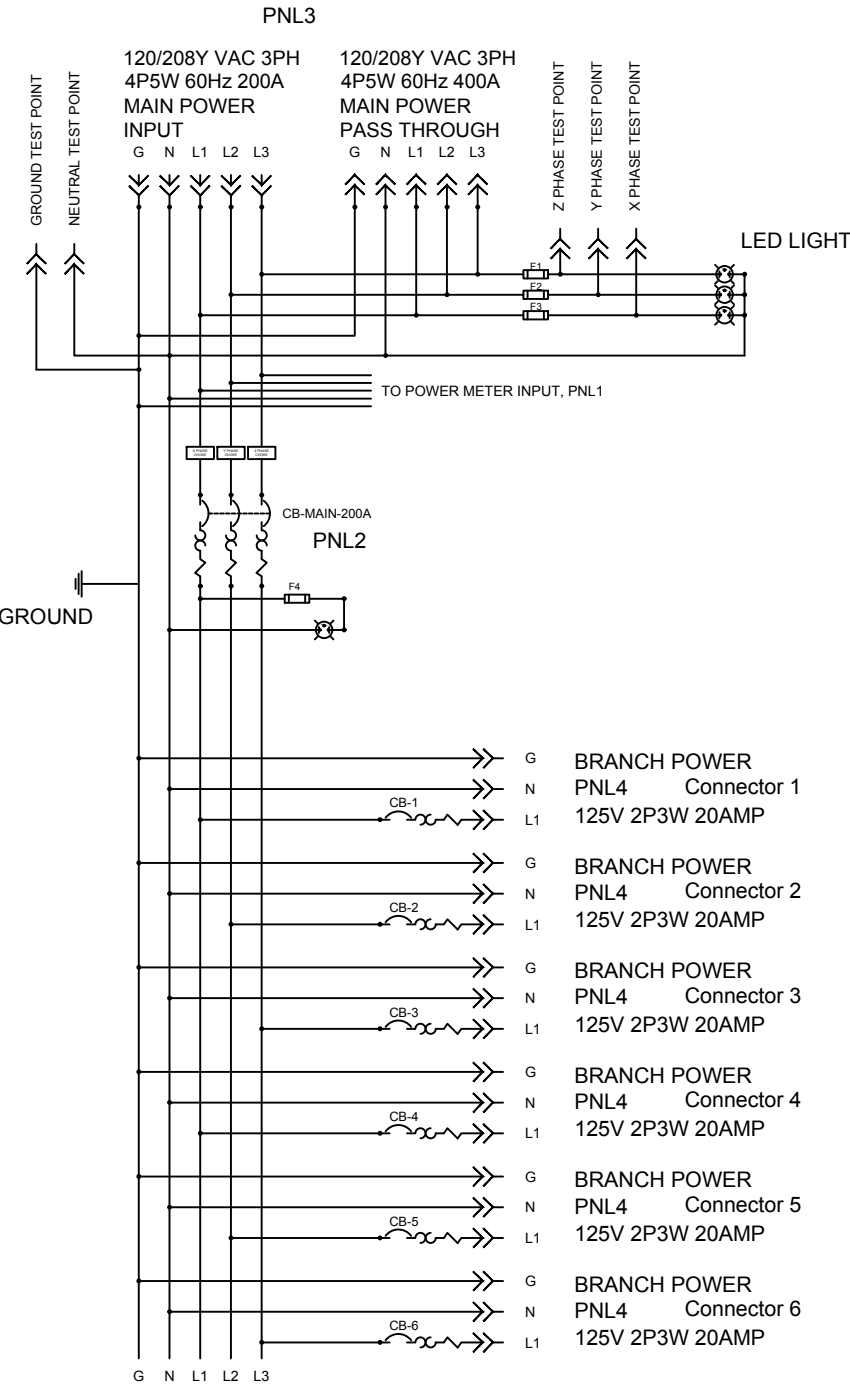

PNL1

PNL2

PNL3

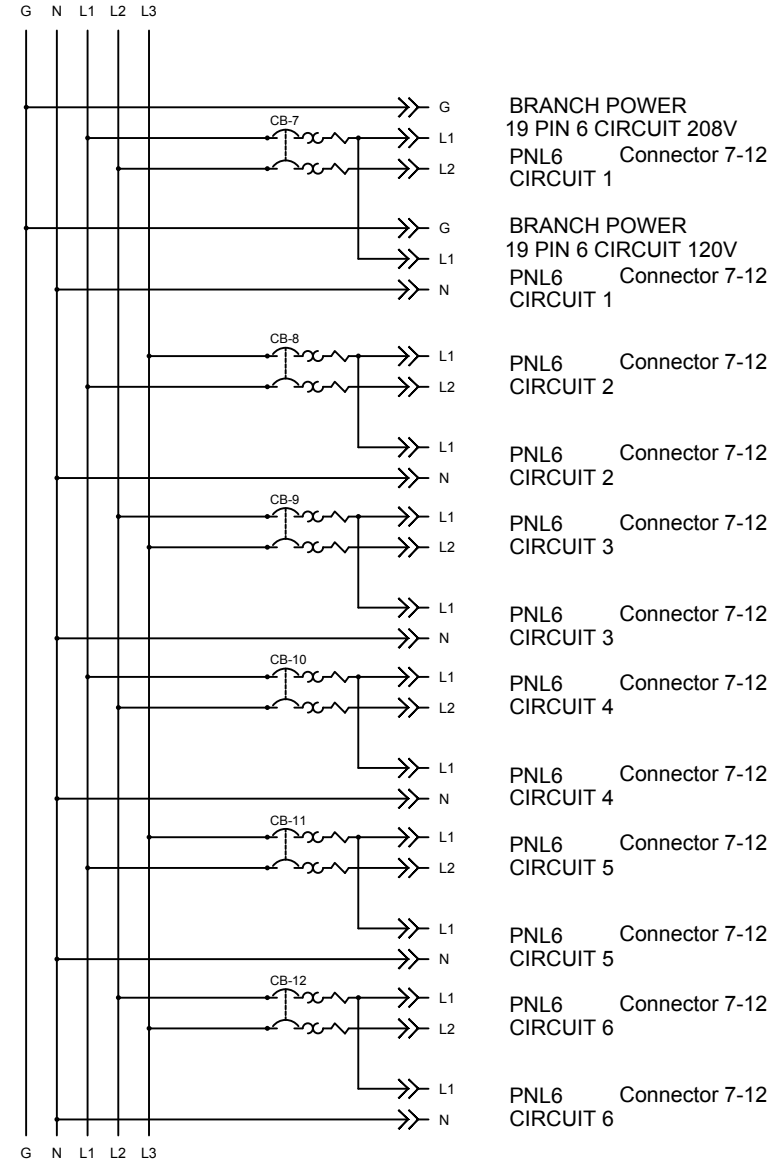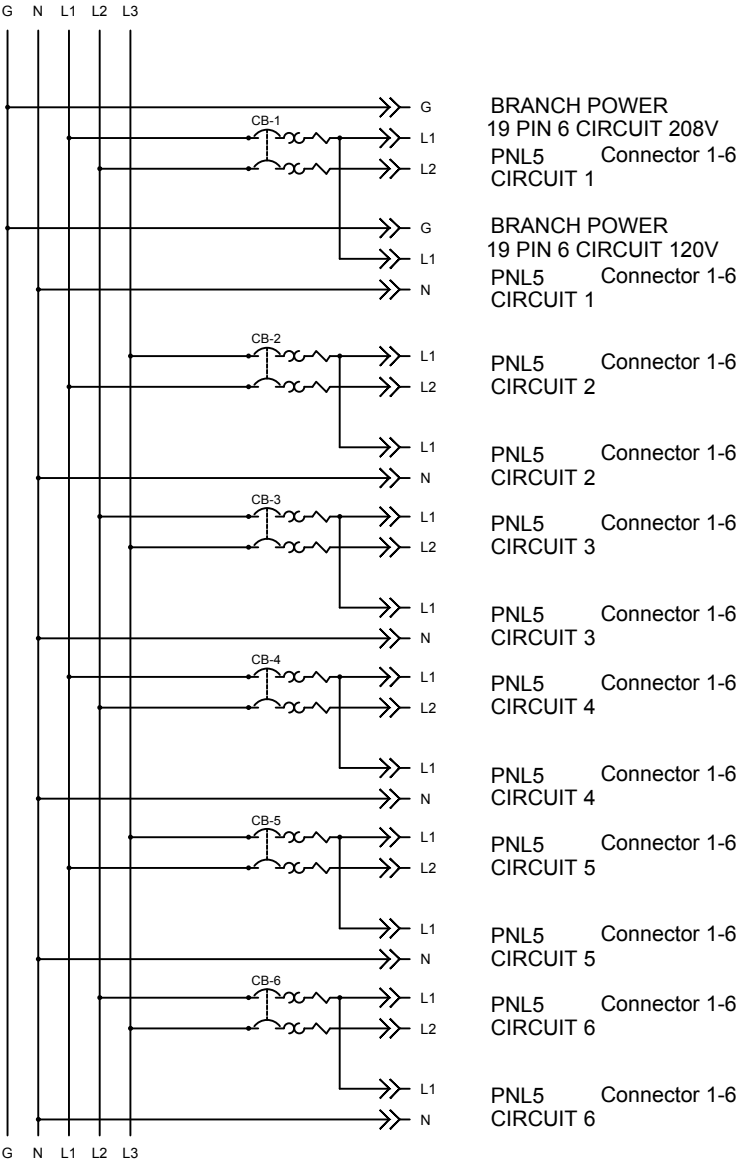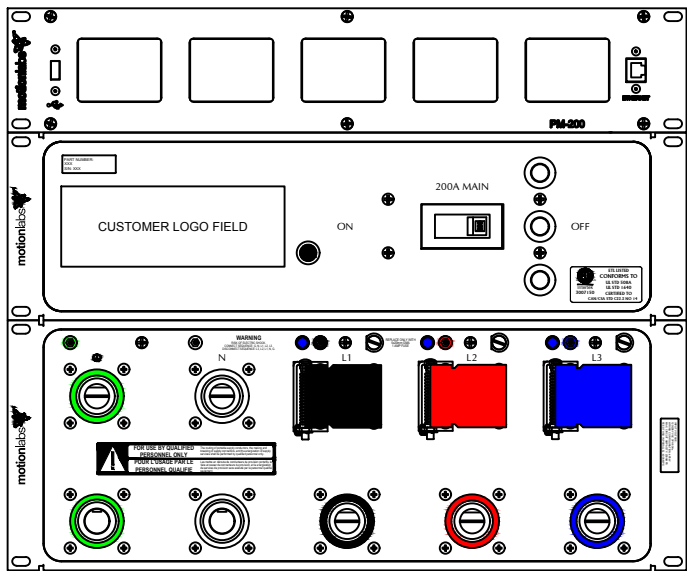

D

C

B

A

REV	DESCRIPTION	Date	APPROVED
B	REVISED PER ECN 100. JM 4/9/18	4/13/18	JK