

D

C

B

A

D

C

B

A

PNL3

120/208Y VAC 3PH
4P5W 60Hz 200A
MAIN POWER
INPUT
G N L1 L2 L3

120/208Y VAC 3PH
4P5W 60Hz 400A
MAIN POWER
PASS THROUGH
G N L1 L2 L3

Z PHASE TEST POINT
Y PHASE TEST POINT
X PHASE TEST POINT

LED LIGHT

TO POWER METER INPUT, PNL1

CB-MAIN-200A

PNL2



F4

GROUND

120VAC
6 CIRCUIT
20 AMPS MAX.

PINOUT: P19-01

1 = H CKT 1
2 = N
3 = H CKT 2
4 = N
5 = H CKT 3
6 = N
7 = H CKT 4
8 = N
9 = H CKT 5
10 = N
11 = H CKT 6
12 = N
13-19 GROUND RING

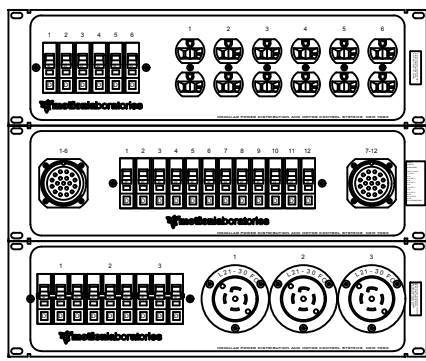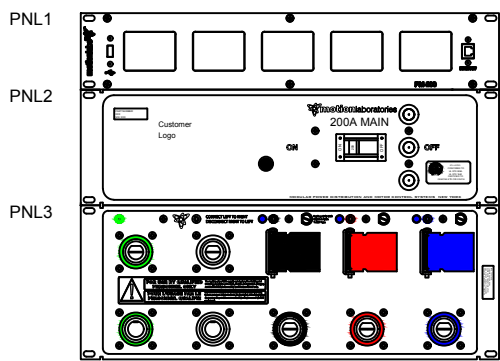

PNL4

PNL5

PNL6

G N L1 L2 L3

BRANCH POWER
19 PIN 6 CIRCUIT 120V
PNL5 Connector 1-6
CIRCUIT 1

CIRCUIT 2

CIRCUIT 3

CIRCUIT 4

CIRCUIT 5

CIRCUIT 6

PNL5 Connector 7-12
CIRCUIT 1

CIRCUIT 2

CIRCUIT 3

CIRCUIT 4

CIRCUIT 5

CIRCUIT 6

G N L1 L2 L3

BRANCH POWER
PNL6
Connector 1
120/208Y VAC 3PH 4P5W 30AMP

BRANCH POWER
PNL6
Connector 2
120/208Y VAC 3PH 4P5W 30AMP

BRANCH POWER
PNL6
Connector 3
120/208Y VAC 3PH 4P5W 30AMP

REV	DESCRIPTION	Date	APPROVED
B	1300-200A-09-2-16 WAS 1302-MAJIC-051817. JM 6/30/17	6/30/17	JK

TITLE:

SCHEMATIC

SIZE

Checked By:

JK

DWG NO.

1300-200A-09-2-16

REV

B

Drawn By:

JM

Sheet

1 OF 1