

D

C

B


A

D

C


B

A

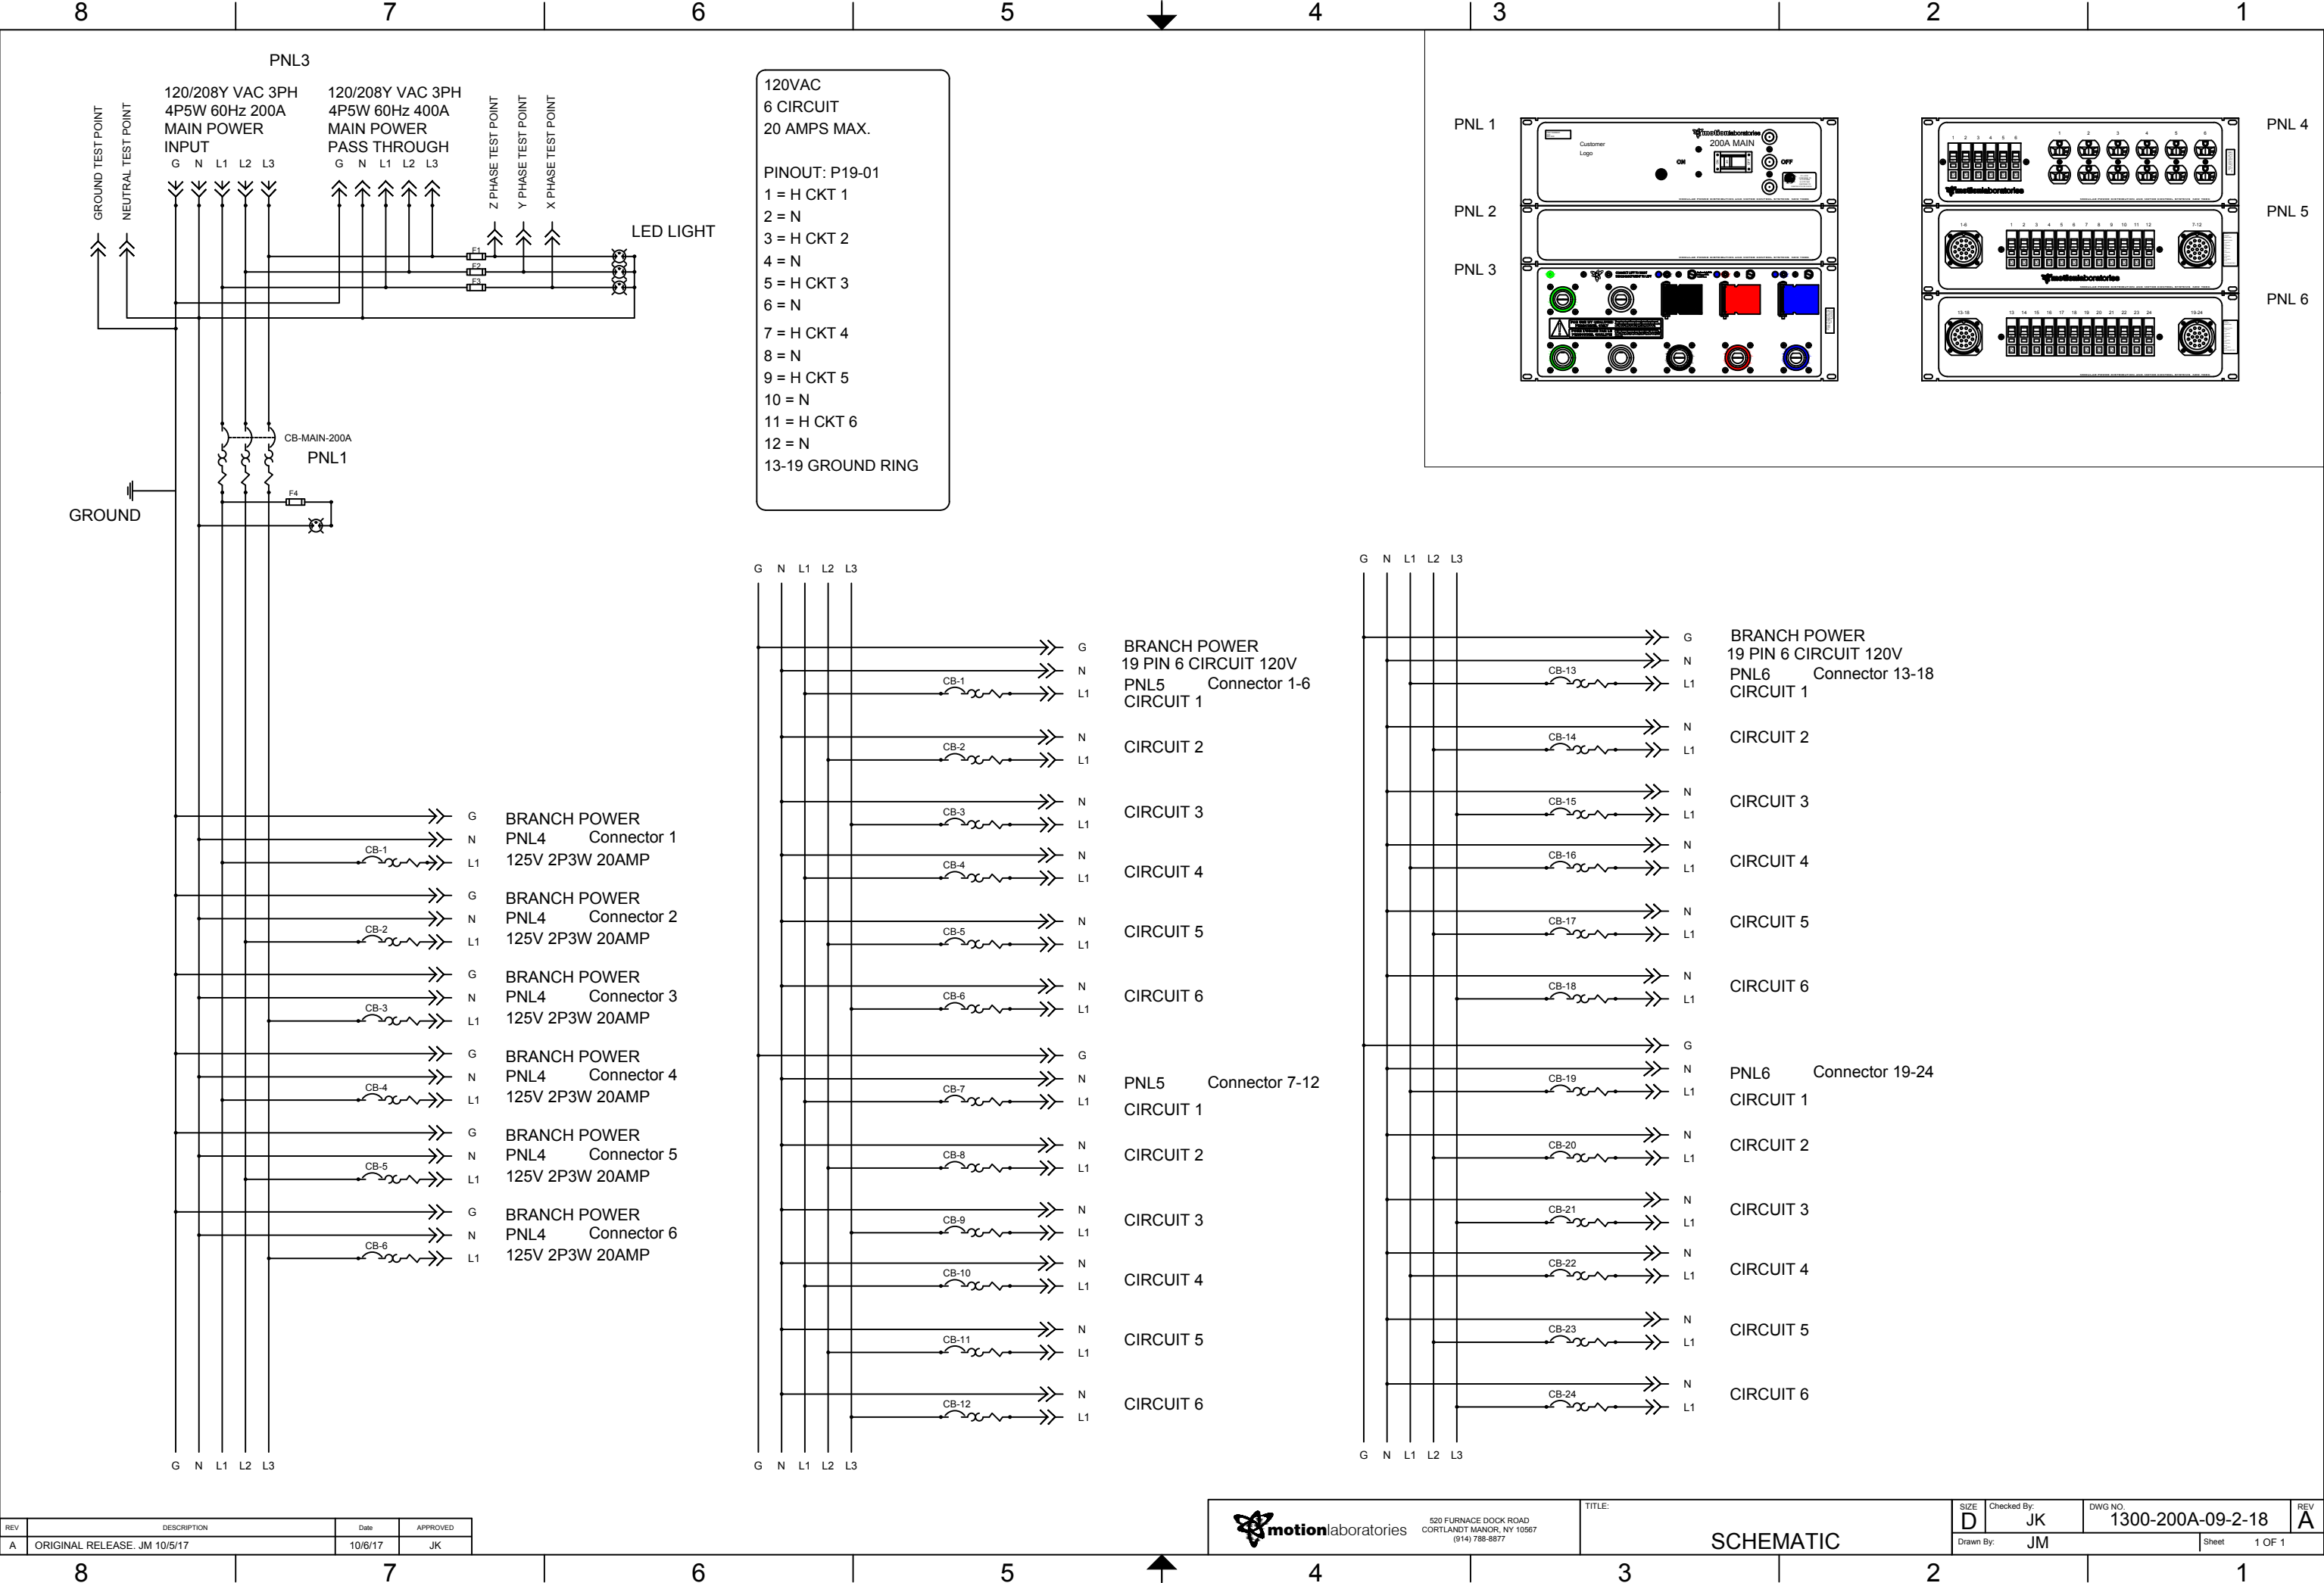

120VAC
6 CIRCUIT
20 AMPS MAX.

PINOUT: P19-01
1 = H CKT 1
2 = N
3 = H CKT 2
4 = N
5 = H CKT 3
6 = N
7 = H CKT 4
8 = N
9 = H CKT 5
10 = N
11 = H CKT 6
12 = N
13-19 GROUND RING

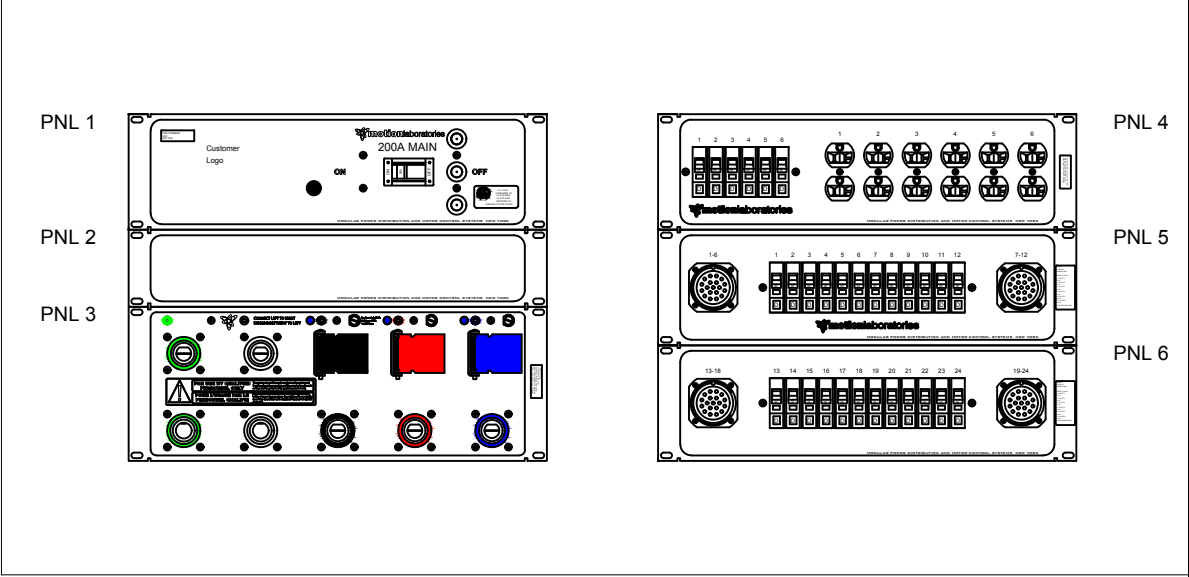

REV	DESCRIPTION	DATE	APPROVED
A	ORIGINAL RELEASE: JM 10/5/17	10/6/17	JK



520 FURNACE DOCK ROAD
CORTLANDT MANOR, NY 10567
(914) 796-6677

TITLE:
SCHEMATIC

SIZE D	Checked By: JK	DWG NO. 1300-200A-09-2-18	REV A
Drawn By: JM		Sheet	1 OF 1