



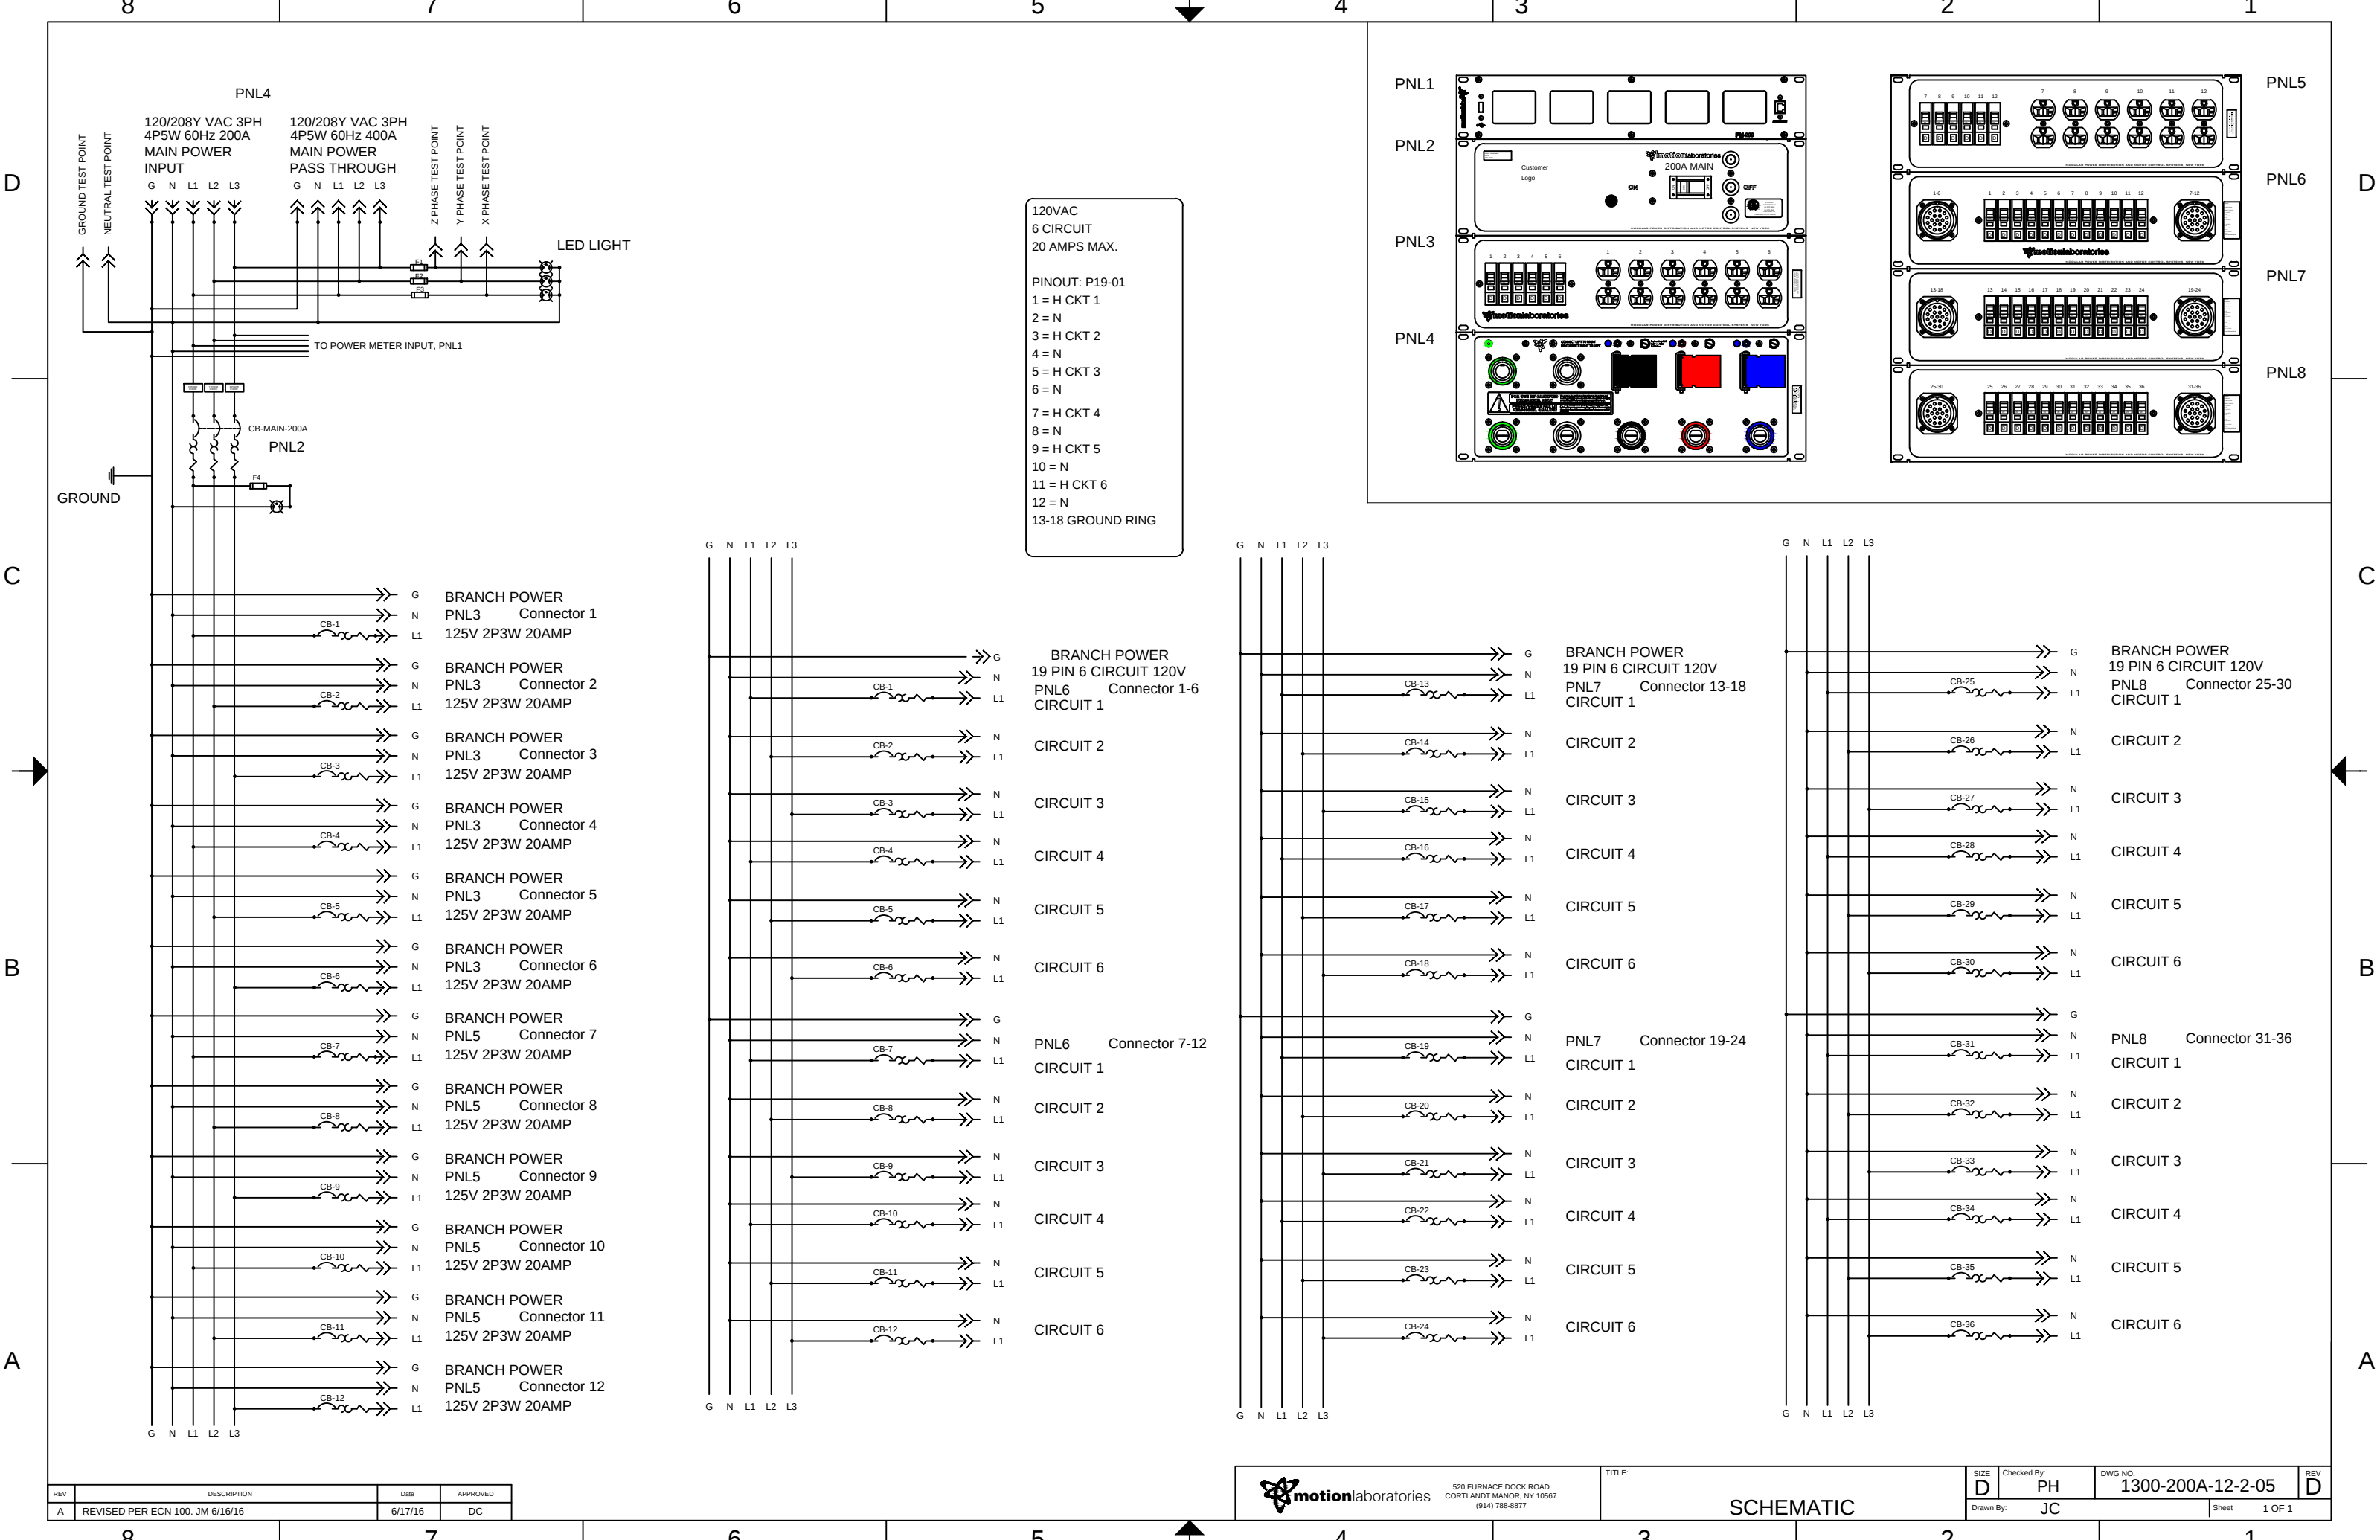

120VAC  
6 CIRCUIT  
20 AMPS MAX.

PINOUT: P19-01  
1 = H CKT 1  
2 = N  
3 = H CKT 2  
4 = N  
5 = H CKT 3  
6 = N  
7 = H CKT 4  
8 = N  
9 = H CKT 5  
10 = N  
11 = H CKT 6  
12 = N  
13-18 GROUND RING

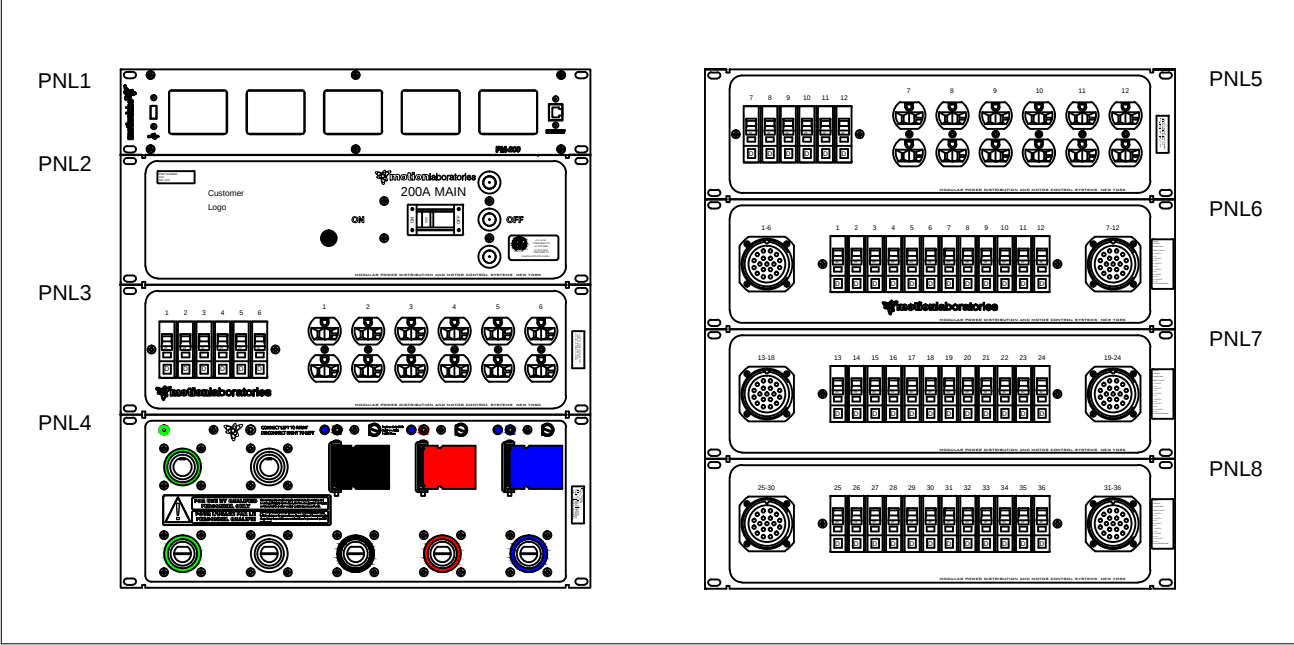

| REV | DESCRIPTION                     | Date    | APPROVED |
|-----|---------------------------------|---------|----------|
| A   | REVISED PER ECN 100. JM 6/16/16 | 6/17/16 | DC       |

|  |                                                                      |                            |  |                  |                          |                                     |                 |
|--|----------------------------------------------------------------------|----------------------------|--|------------------|--------------------------|-------------------------------------|-----------------|
|  | 520 FURNACE DOCK ROAD<br>CORTLANDT MANOR, NY 10567<br>(914) 786-9877 | TITLE:<br><b>SCHEMATIC</b> |  | SIZE<br><b>D</b> | Checked By:<br><b>PH</b> | DWG NO.<br><b>1300-200A-12-2-05</b> | REV<br><b>D</b> |
|  |                                                                      | Drawn By:<br><b>JC</b>     |  | Sheet 1 OF 1     |                          |                                     |                 |