

D

C

B

A

D


C

B

A

REV	DESCRIPTION	Date	APPROVED
B	UPDATED PER ECN 100. SB 2/24/17	3/2/17	DC

	520 FURNACE DOCK ROAD CORTLANDT MANOR, NY 10567 (914) 796-6677	TITLE: SCHEMATIC	SIZE D	Checked By: PH	DWG NO. 1300-200A-12-2-18	REV B
			Drawn By: JC	Sheet 1 OF 1		

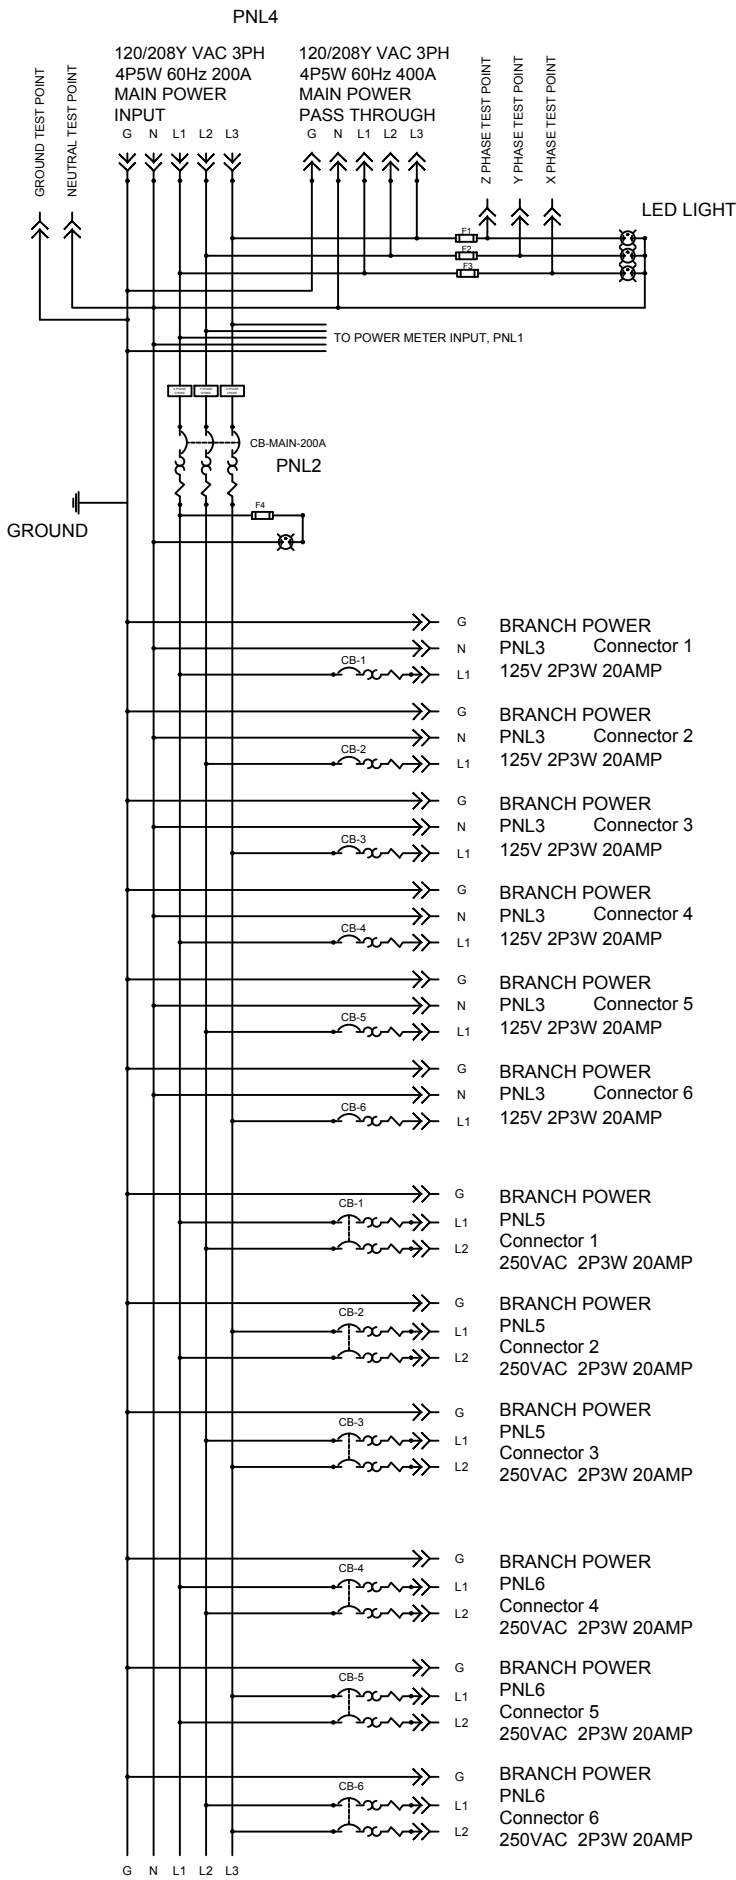

120VAC
6 CIRCUIT
20 AMPS MAX.

PINOUT: P19-01
1 = H CKT 1
2 = N
3 = H CKT 2
4 = N
5 = H CKT 3
6 = N
7 = H CKT 4
8 = N
9 = H CKT 5
10 = N
11 = H CKT 6
12 = N
13-19 GROUND RING

