



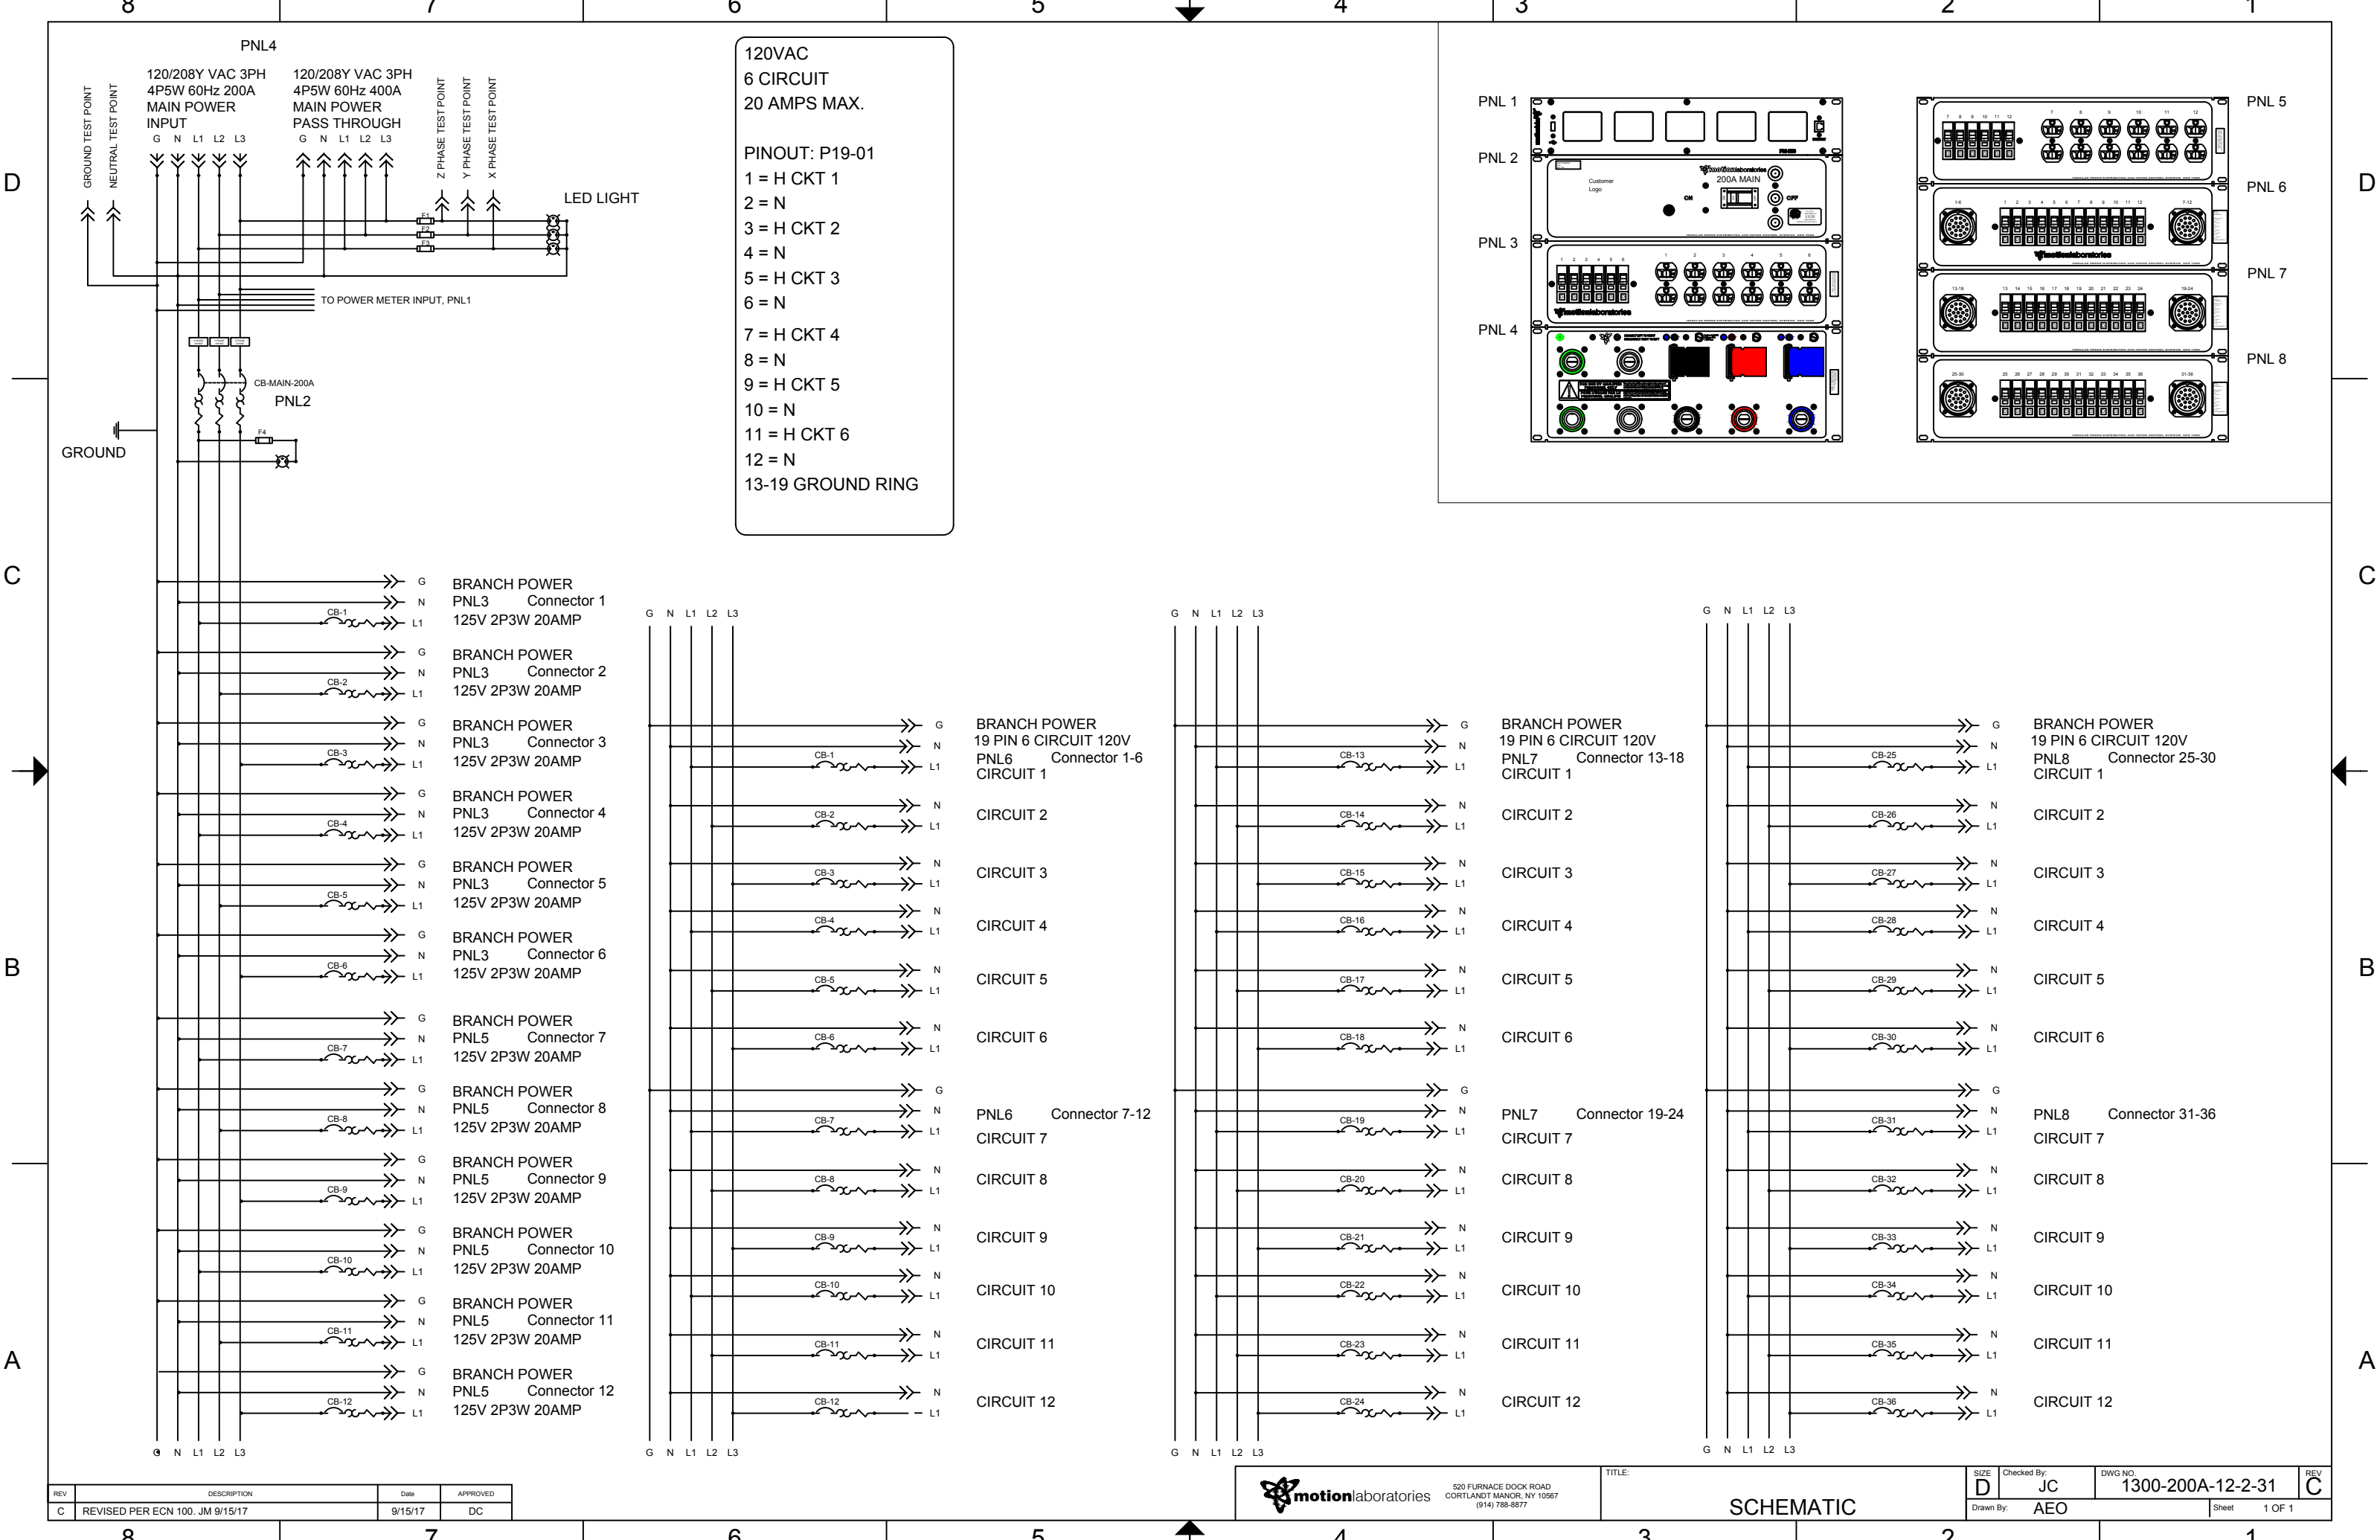

120VAC
6 CIRCUIT
20 AMPS MAX.

PINOUT: P19-01
1 = H CKT 1
2 = N
3 = H CKT 2
4 = N
5 = H CKT 3
6 = N
7 = H CKT 4
8 = N
9 = H CKT 5
10 = N
11 = H CKT 6
12 = N
13-19 GROUND RING

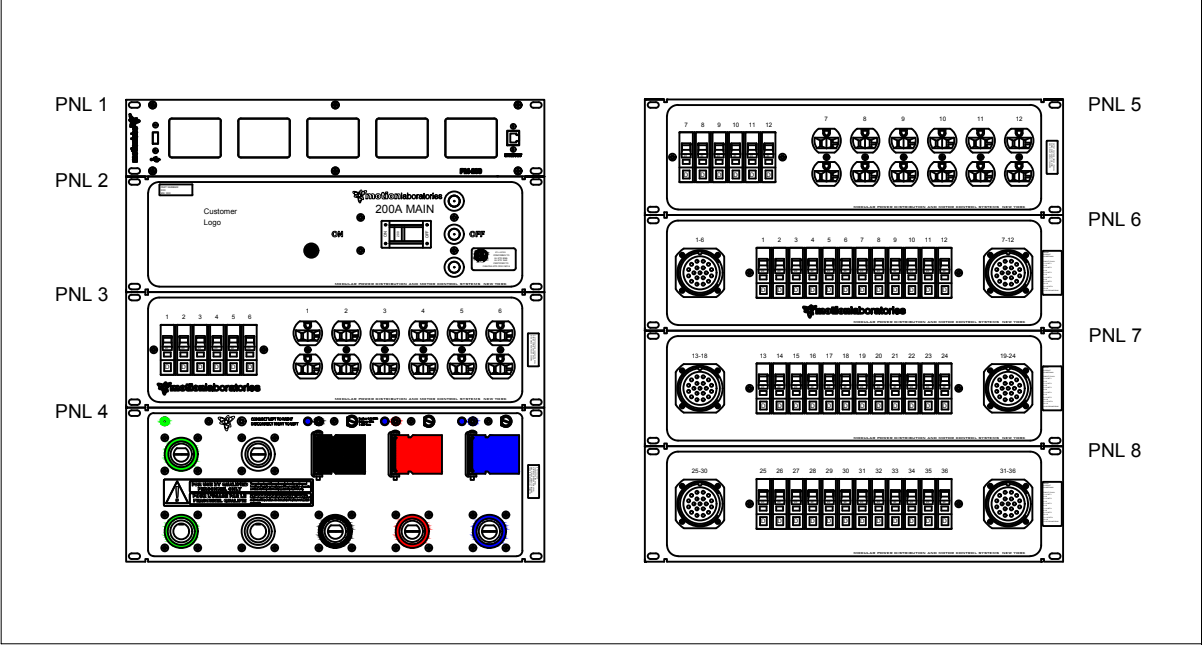

REV	DESCRIPTION	Date	APPROVED
C	REVISED PER ECN 100, JM 9/15/17	9/15/17	DC



520 FURNACE DOCK ROAD
CORTLANDT MANOR, NY 10567
(914) 796-6677

TITLE:
SCHEMATIC

SIZE D	Checked By: JC	DWG NO. 1300-200A-12-2-31	REV C
Drawn By: AEO		Sheet	1 OF 1