

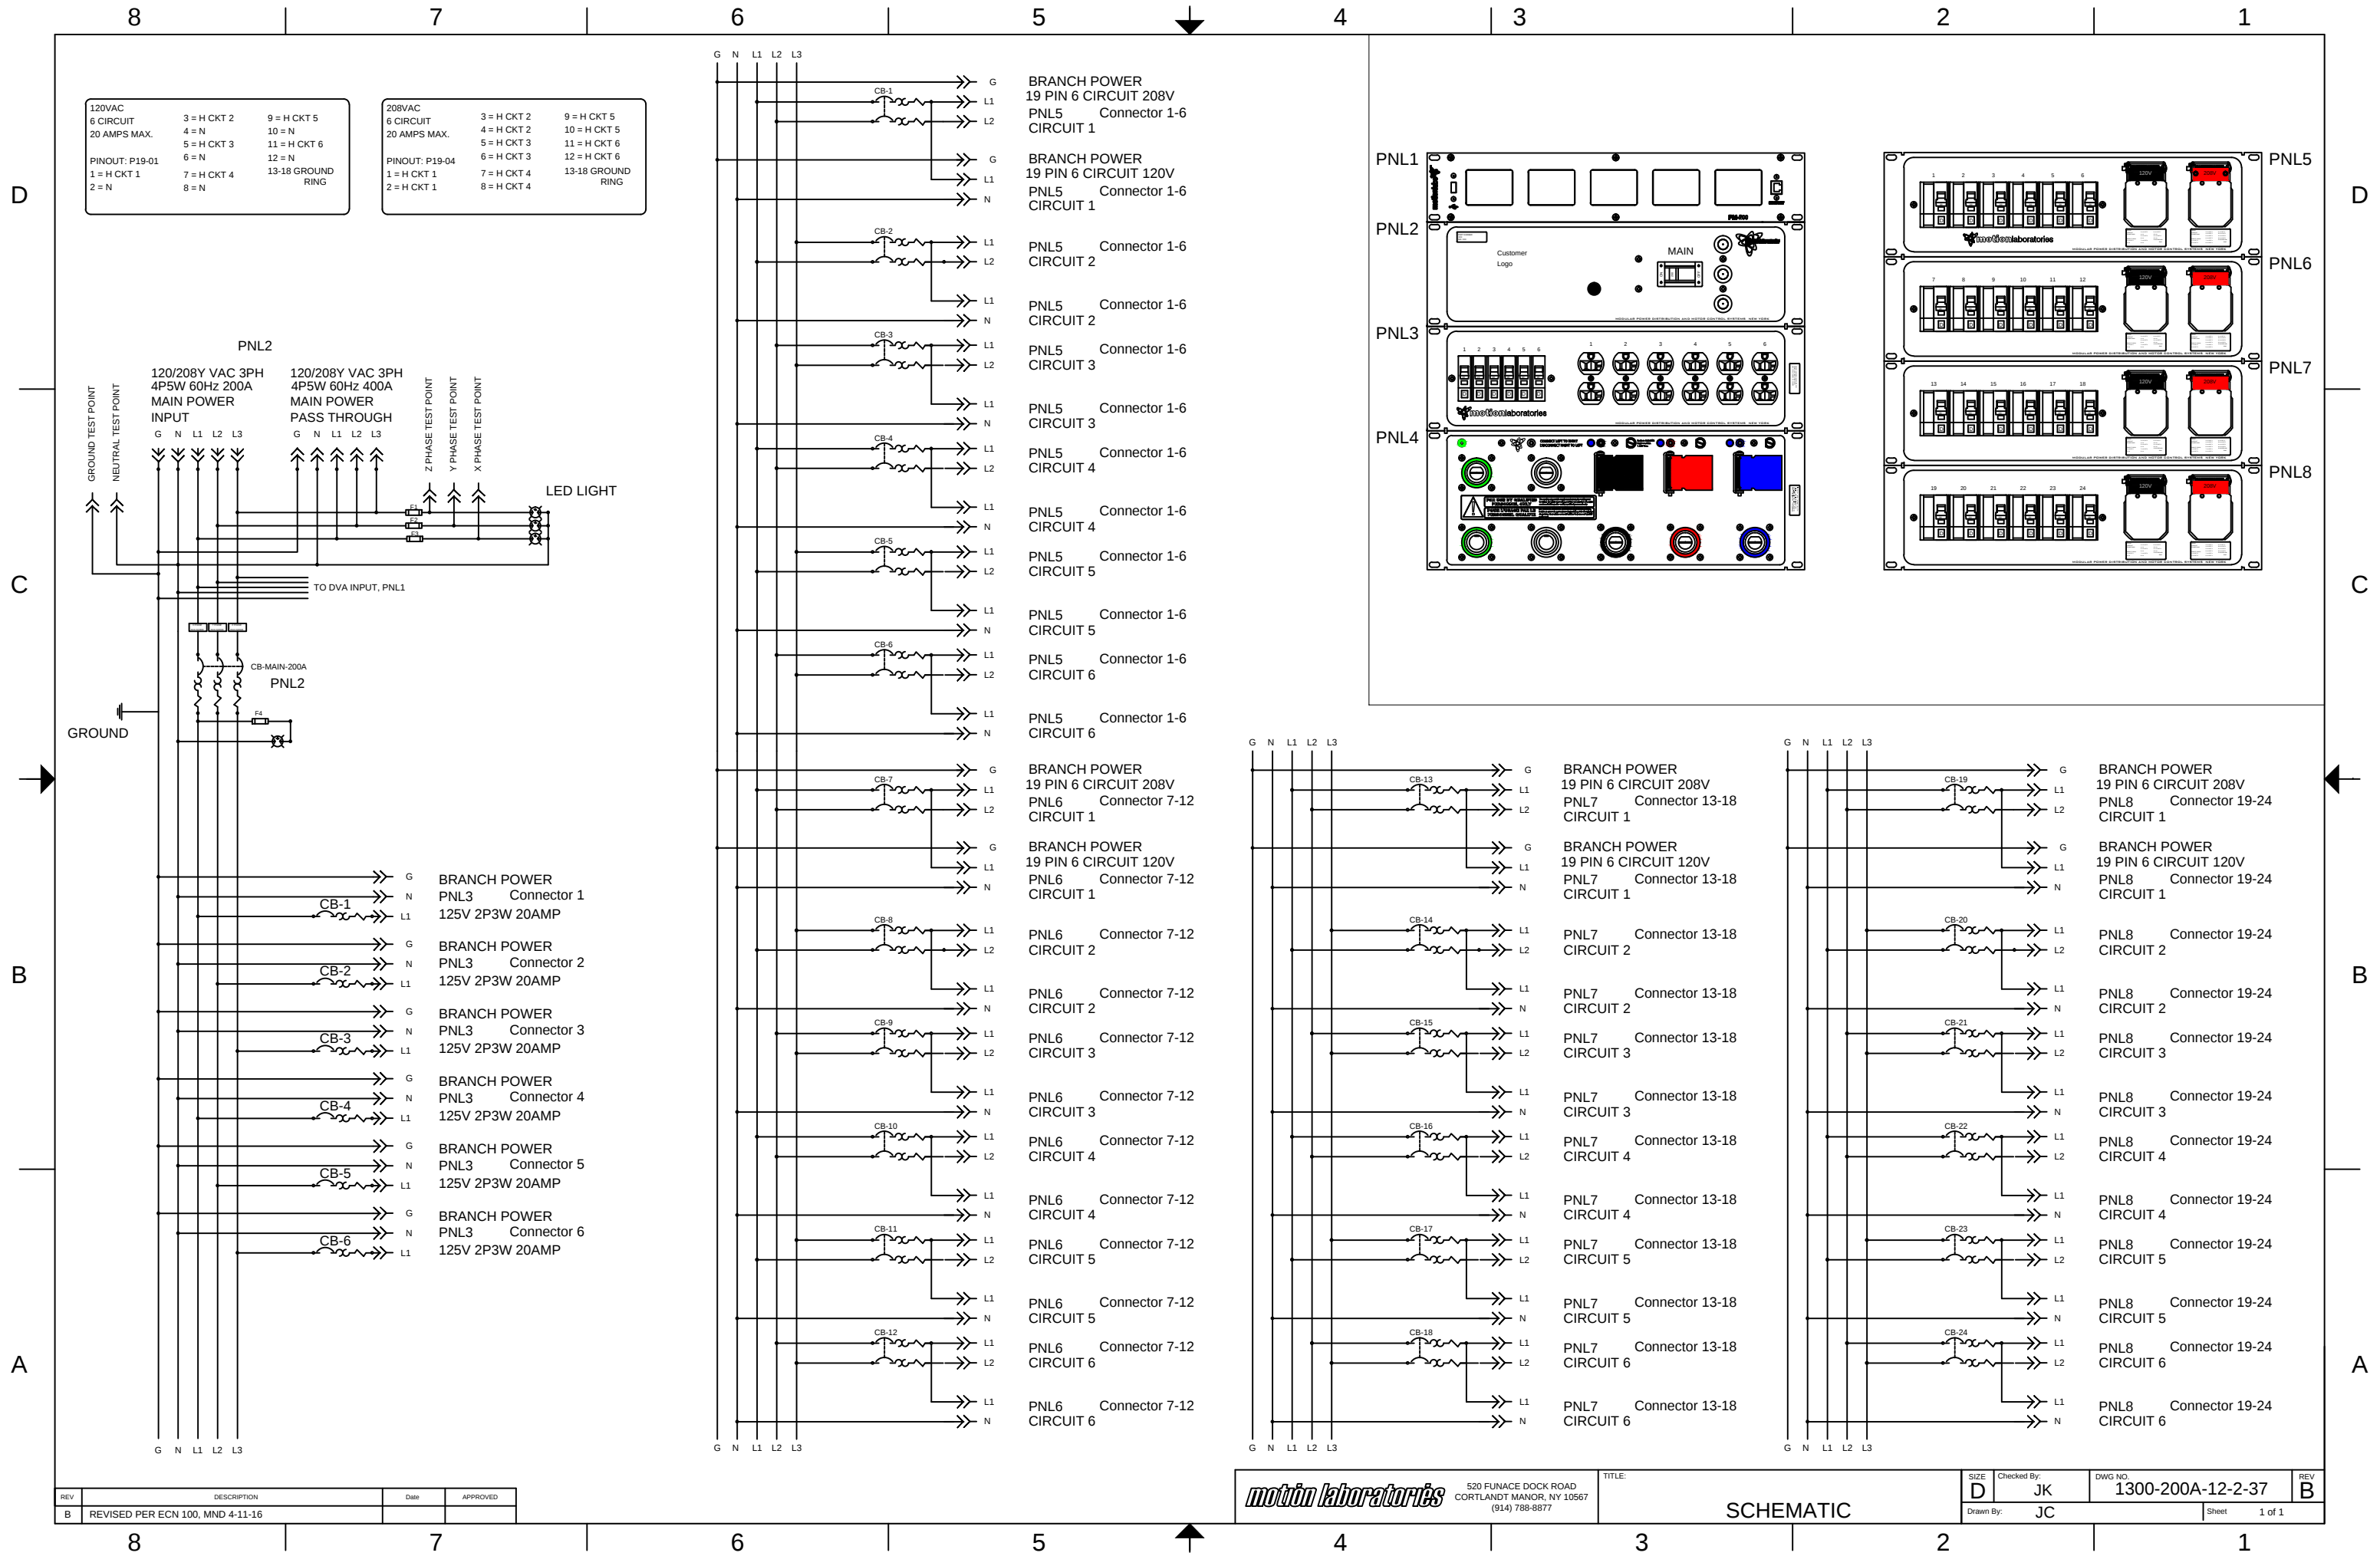
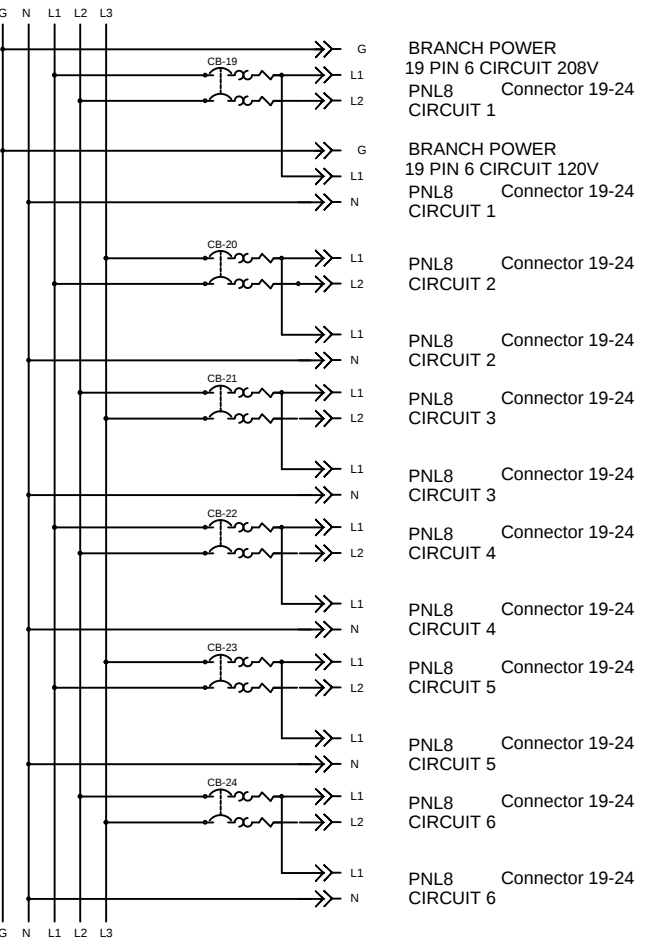
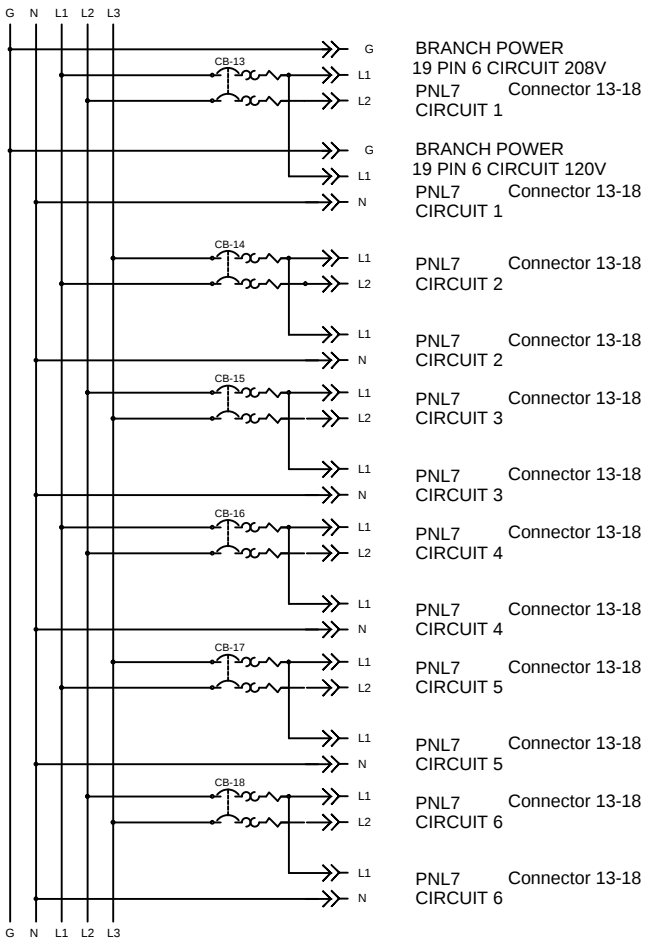
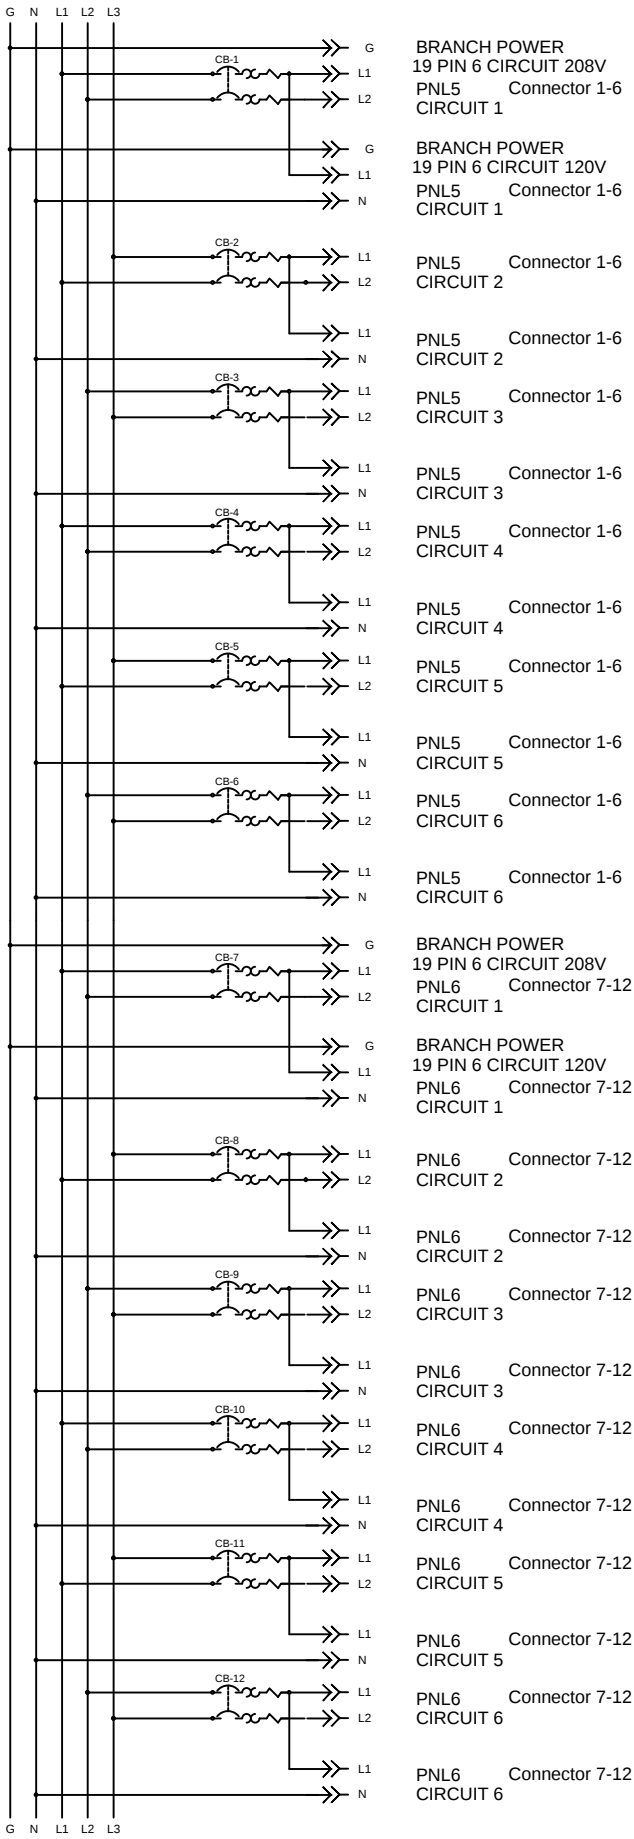


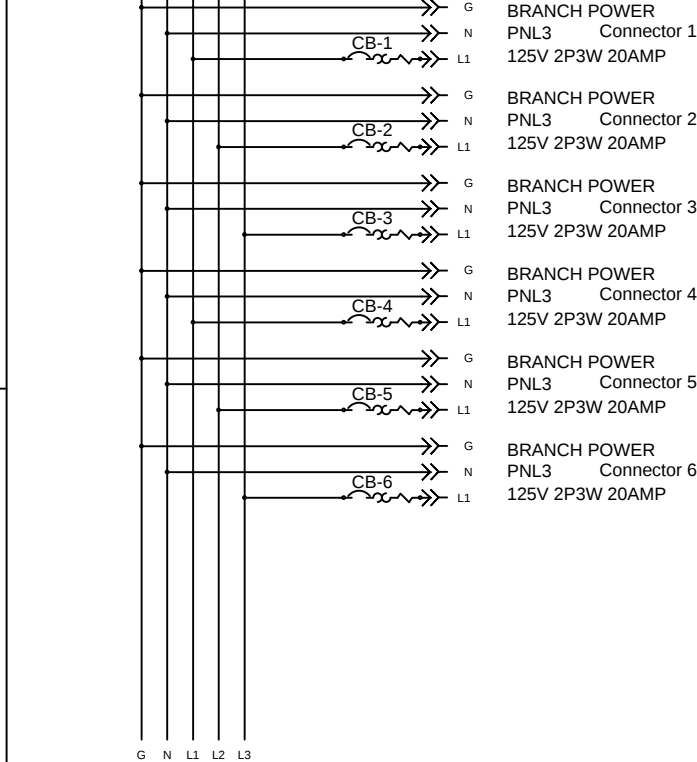

120VAC 6 CIRCUIT 20 AMPS MAX. PINOUT: P19-01 1 = H CKT 1 2 = N	3 = H CKT 2 4 = N 5 = H CKT 3 6 = N 7 = H CKT 4 8 = N	9 = H CKT 5 10 = N 11 = H CKT 6 12 = N 13-18 GROUND RING
208VAC 6 CIRCUIT 20 AMPS MAX. PINOUT: P19-04 1 = H CKT 1 2 = H CKT 1	3 = H CKT 2 4 = H CKT 2 5 = H CKT 3 6 = H CKT 3 7 = H CKT 4 8 = H CKT 4	9 = H CKT 5 10 = H CKT 5 11 = H CKT 6 12 = H CKT 6 13-18 GROUND RING

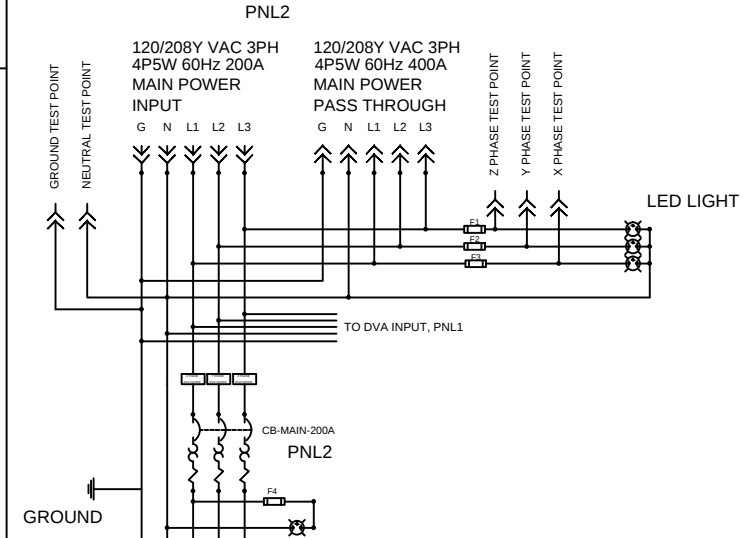

REV	DESCRIPTION	DATE	APPROVED
B	REVISED PER ECN 100, MND 4-11-16		

<i>motion laboratories</i>	520 FUNACE DOCK ROAD CORTLANDT MANOR, NY 10567 (914) 788-8877	TITLE: SCHEMATIC	SIZE	Checked By:	DWG NO.	REV
			D	JK	1300-200A-12-2-37	B
			Drawn By:	JC	Sheet	1 of 1