

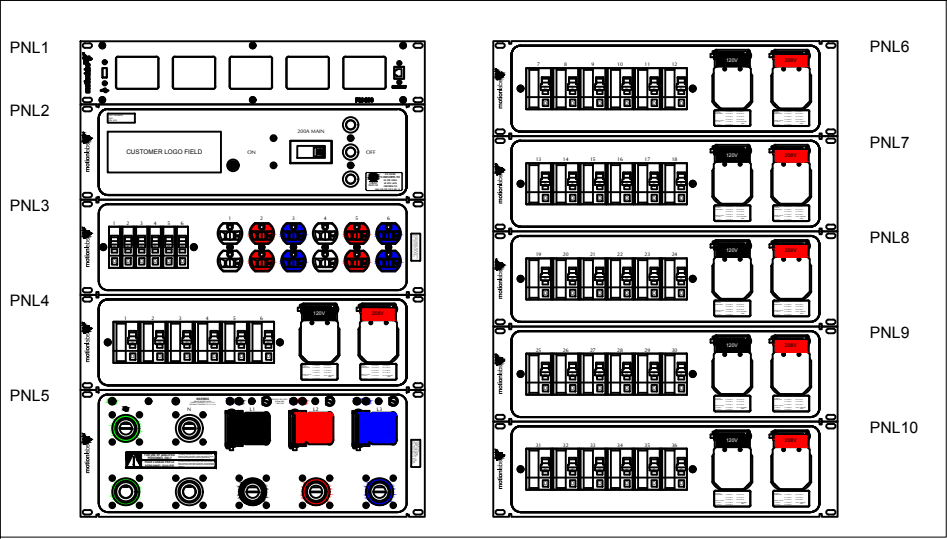
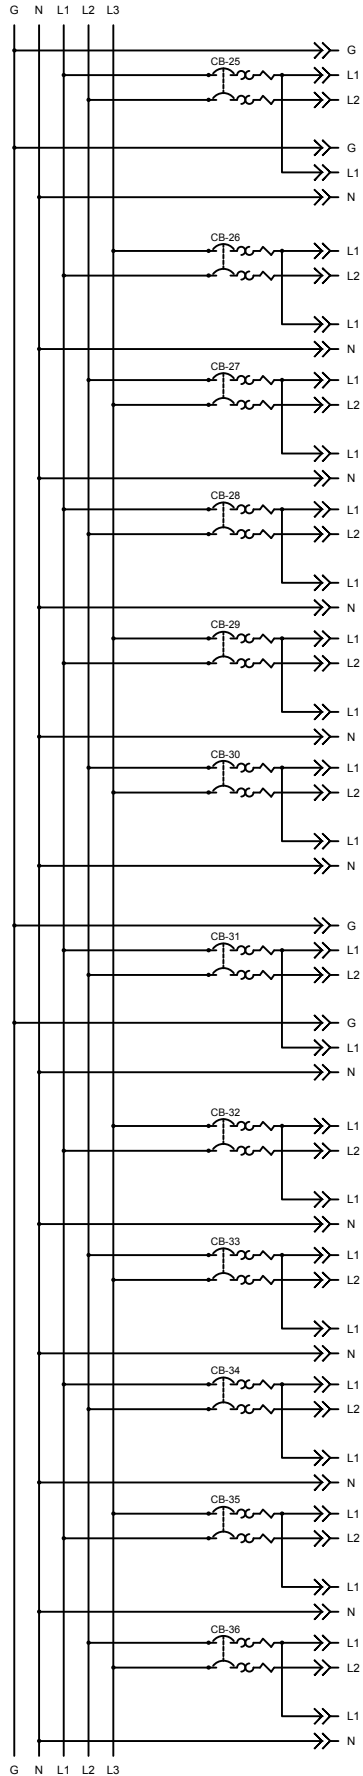
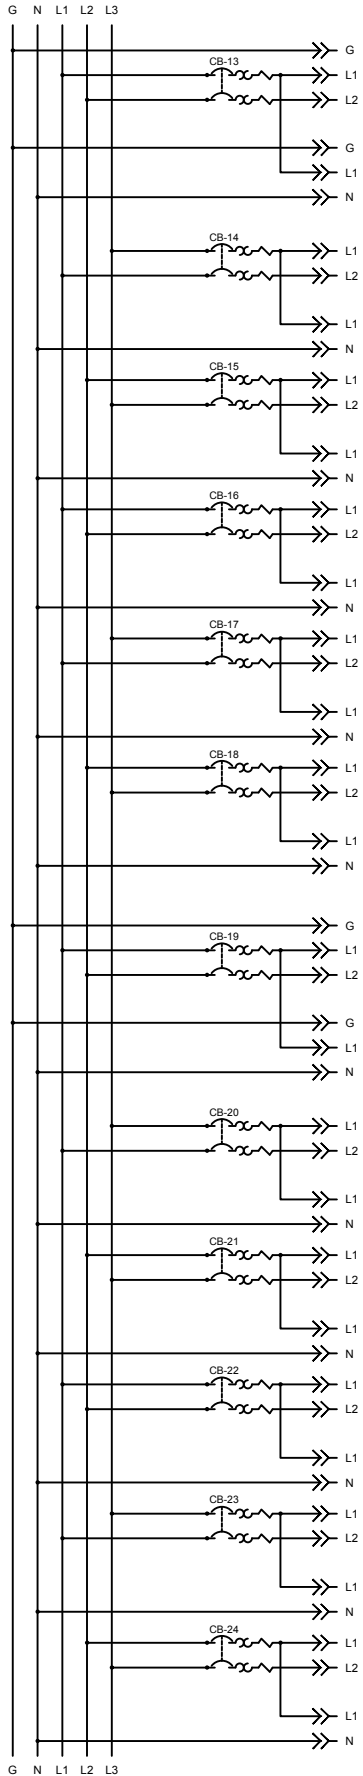


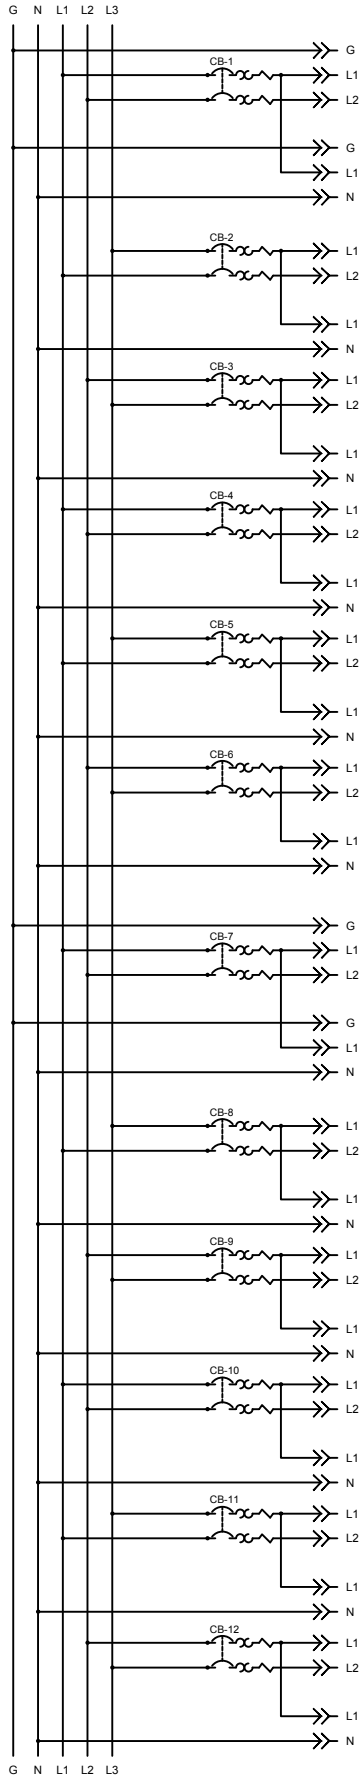

120VAC 6 CIRCUIT 20AMPS MAX	3 = H CKT 2 4 = N CKT 2 5 = H CKT 3 6 = N CKT 3 7 = H CKT 4 8 = N CKT 4	9 = H CKT 5 10 = N CKT 5 11 = H CKT 6 12 = N CKT 6 13-19 = GROUND RING
PINOUT: P19-01 1 = H CKT 1 2 = N CKT 1		

208VAC 6 CIRCUIT 20AMPS MAX	3 = H CKT 2 4 = H CKT 2 5 = H CKT 3 6 = H CKT 3 7 = H CKT 4 8 = H CKT 4	9 = H CKT 5 10 = H CKT 5 11 = H CKT 6 12 = H CKT 6 13-19 = GROUND RING
PINOUT: P19-04 1 = H CKT 1 2 = H CKT 1		

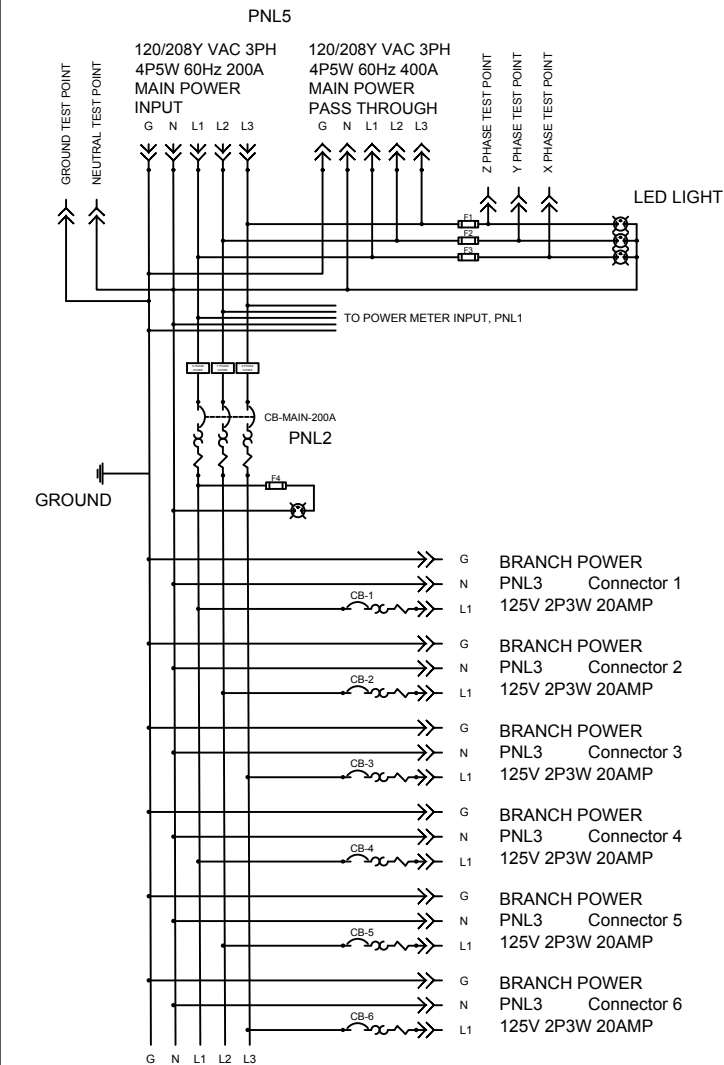

REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER ECN 100. JK 2/9/22	2/11/22	SB

motionlabs 520 Furnace Dock Road Cortlandt Manor, NY 10567		TITLE SCHEMATIC		DRAWN BY JK	DATE DRAWN 3/27/14	SIZE D	DRAWING NUMBER 1300-200A-15-2-03	REV C
COPYRIGHT 2004 BY MOTIONLABS, INC. ALL RIGHTS RESERVED. THIS DOCUMENT IS THE SOLE PROPERTY OF MOTIONLABS, INC. AND IT SHALL NOT BE REPRODUCED, COPIED, OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN AND EXPRESS PERMISSION OF MOTIONLABS, INC. IN WHOLE OR IN PART.		MODEL FILENAME & PATH N:\Engineering\Schematics\Final Assembly\1300-200A-15-2-03.dwg		SHEET 1 OF 1				