

D

C

B

A






D

C

B

A

120VAC 6 CIRCUIT 20 AMPS MAX. PNCUT: P19-01 1 = H CKT 1 2 = N	3 = H CKT 2 4 = N 5 = H CKT 3 6 = N 7 = H CKT 4 8 = N	9 = H CKT 5 10 = N 11 = H CKT 6 12 = N 13-19 GROUND RING
208VAC 6 CIRCUIT 20 AMPS MAX. PNCUT: P19-04 1 = H CKT 1 2 = H CKT 1	3 = H CKT 2 4 = H CKT 2 5 = H CKT 3 6 = H CKT 3 7 = H CKT 4 8 = H CKT 4	9 = H CKT 5 10 = H CKT 5 11 = H CKT 6 12 = H CKT 6 13-19 GROUND RING

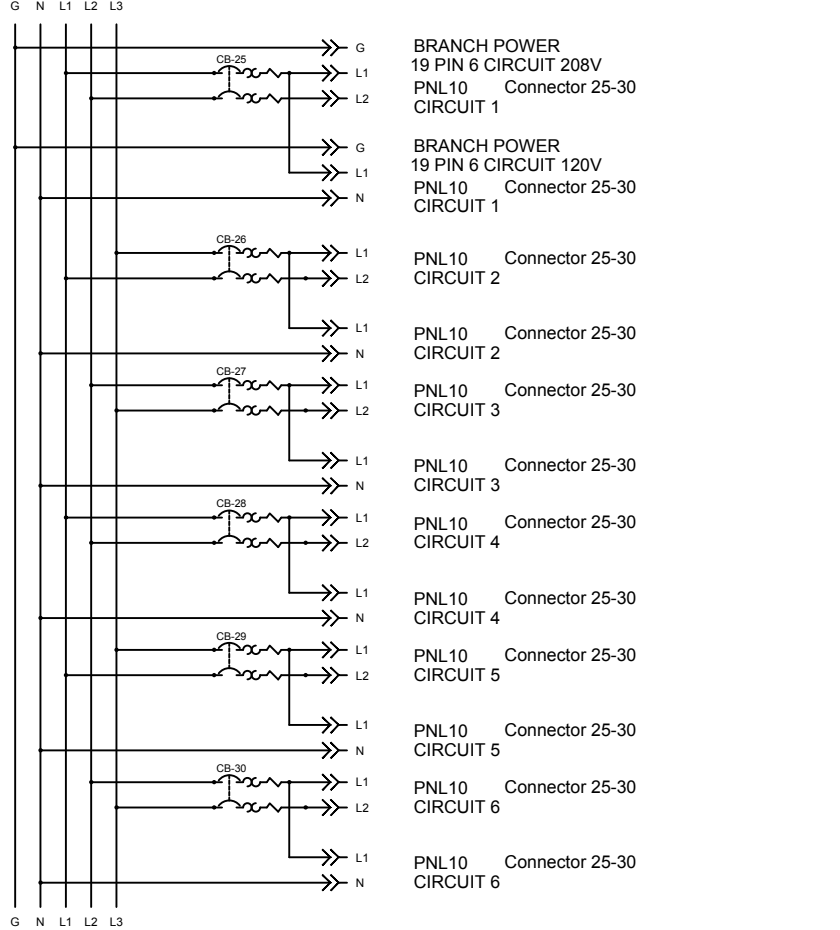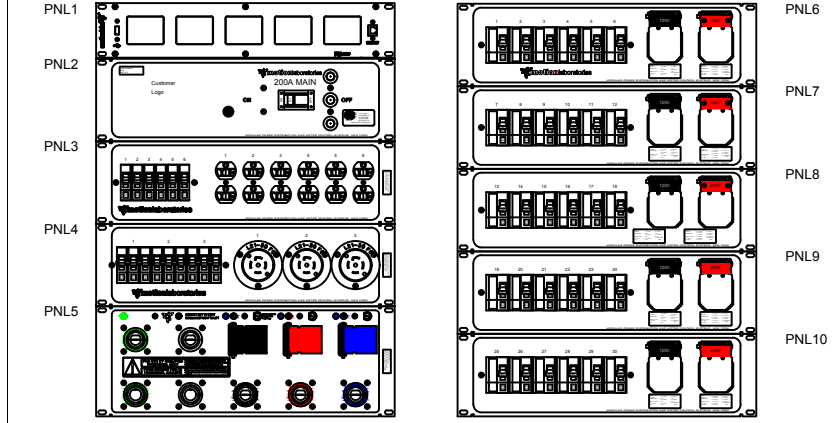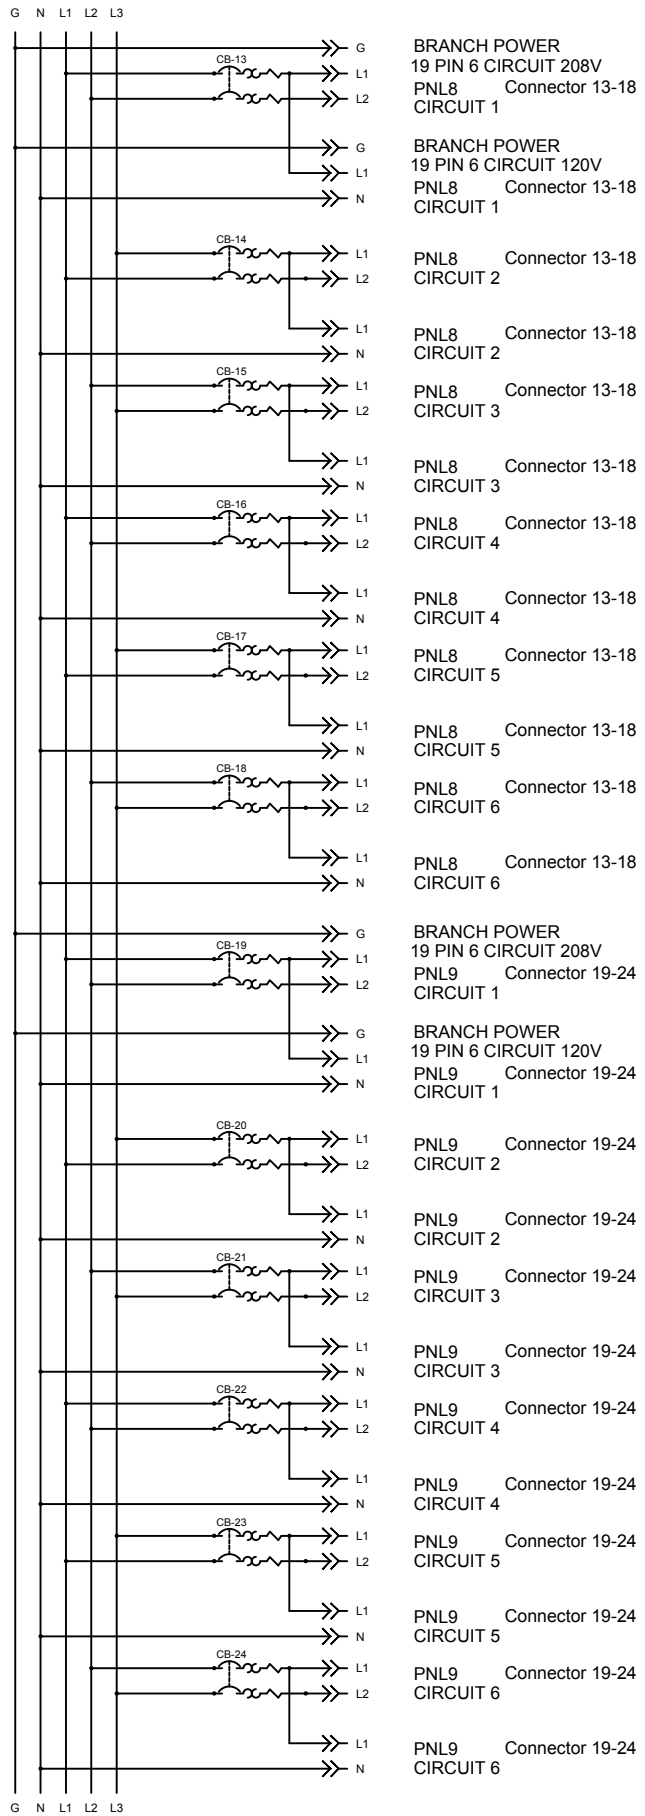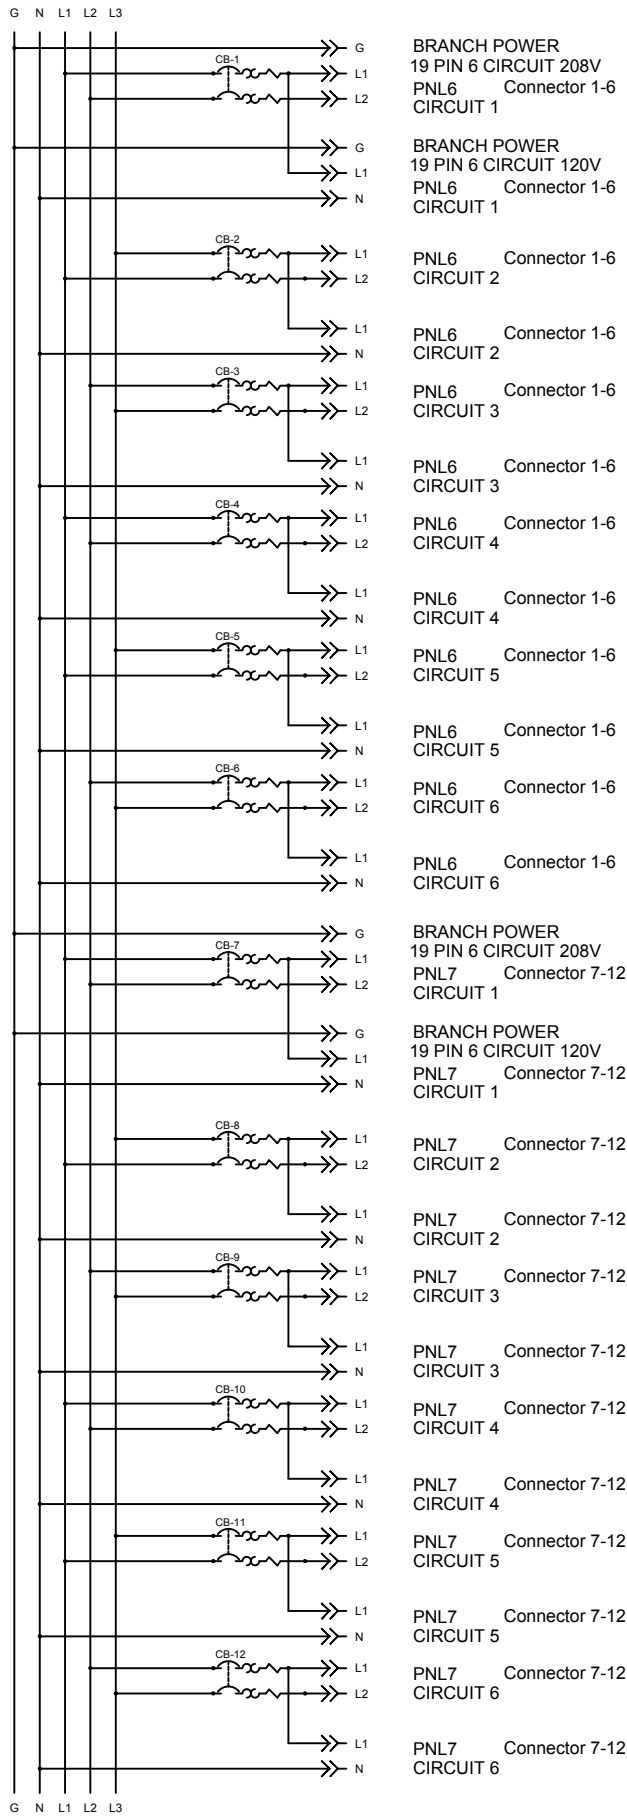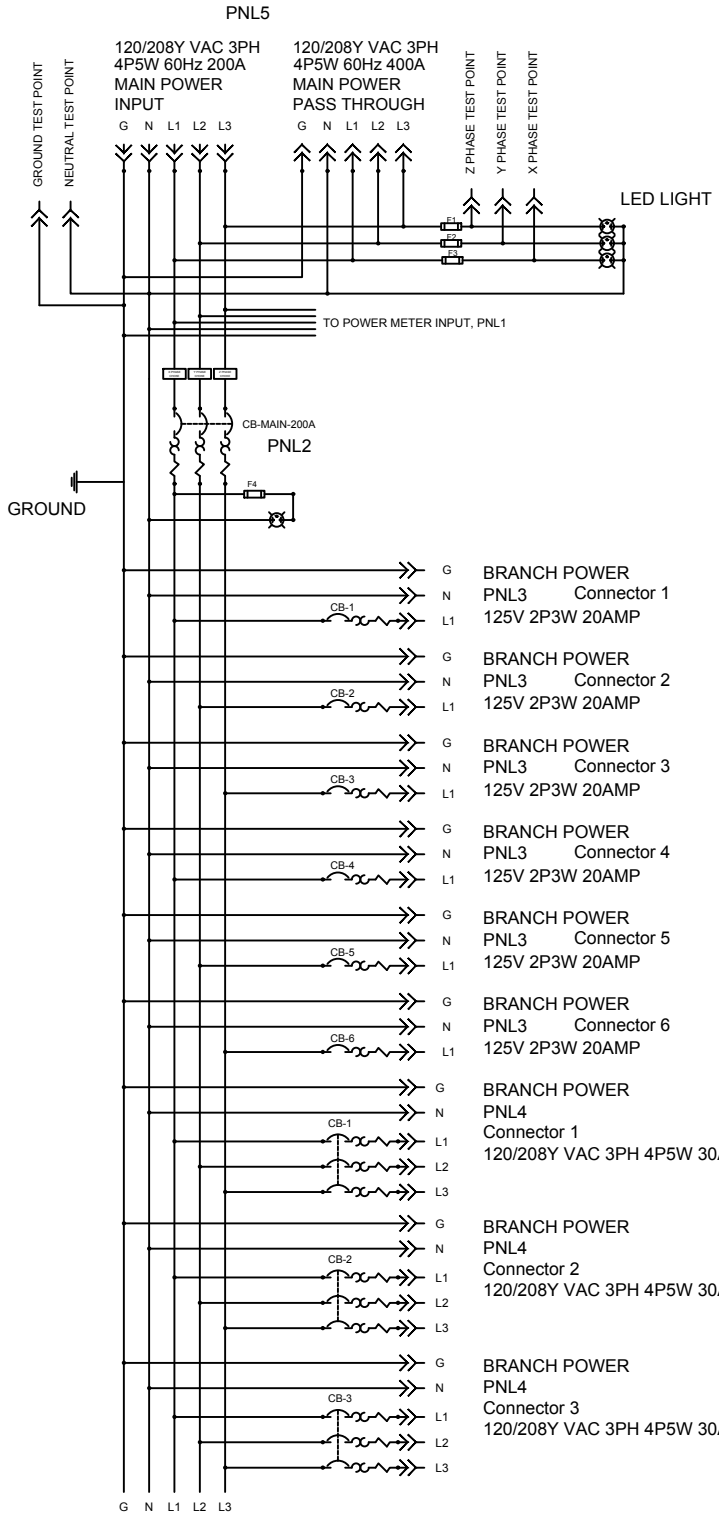

REV	DESCRIPTION	Date	APPROVED
D	PART NUMBER 1300-200A-15-2-06 WAS 1302-MAGNUM-112012 JM 1/12/17	1/18/17	DC

 520 FURNACE DOCK ROAD CORTLANDT MANOR, NY 10567 (914) 788-8877	TITLE: SCHEMATIC	SIZE D	Checked By: PH	DWG NO. 1300-200A-15-2-06	REV D
		Drawn By: JC	Sheet 1 OF 1		