

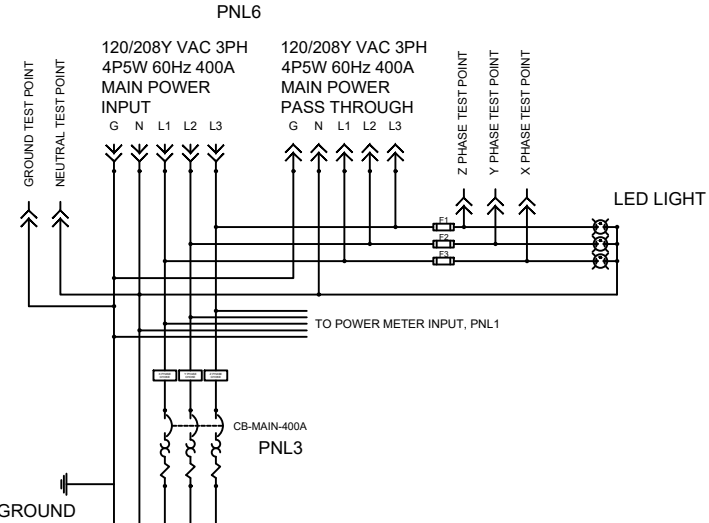
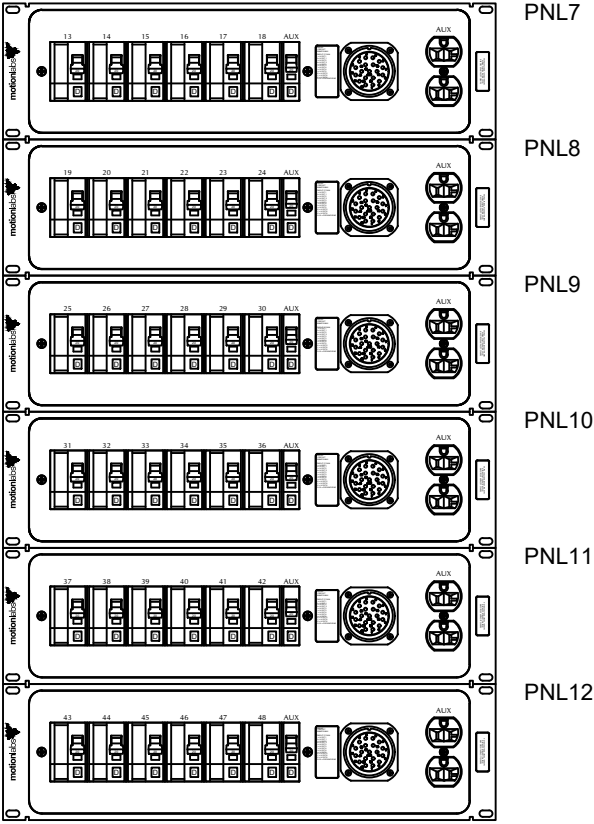
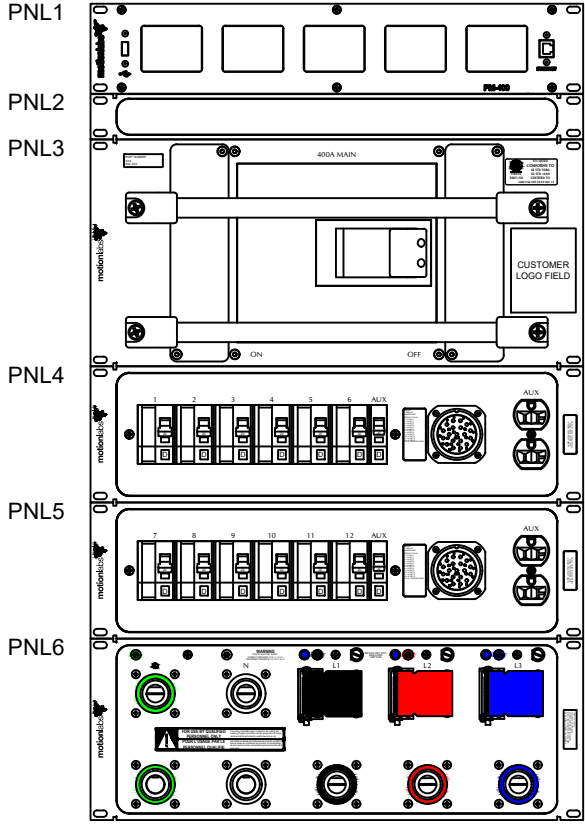
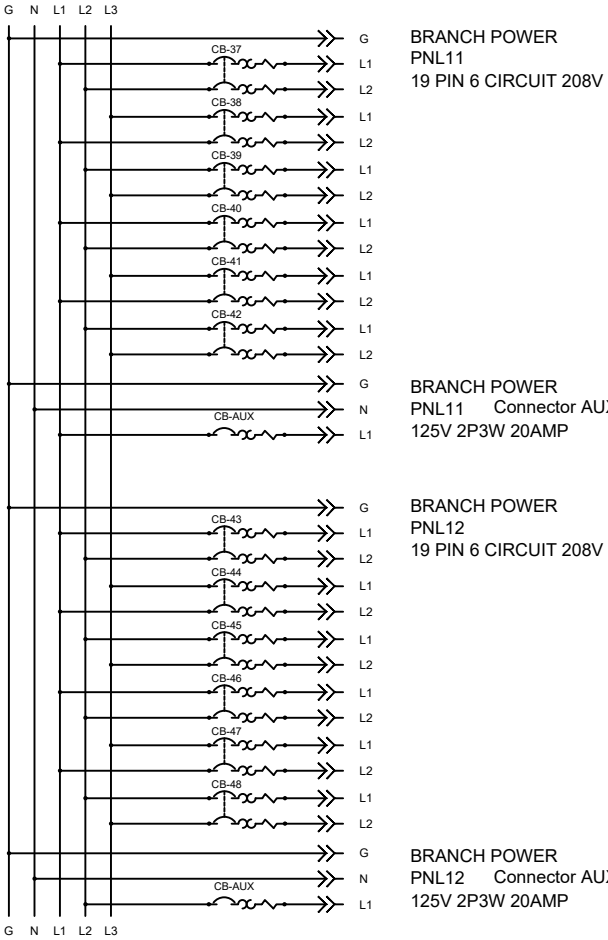
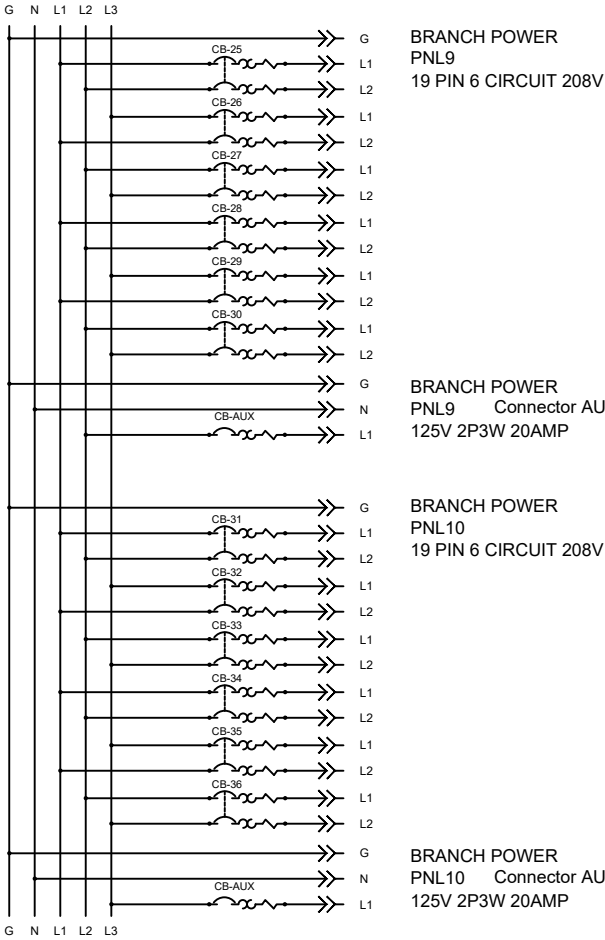


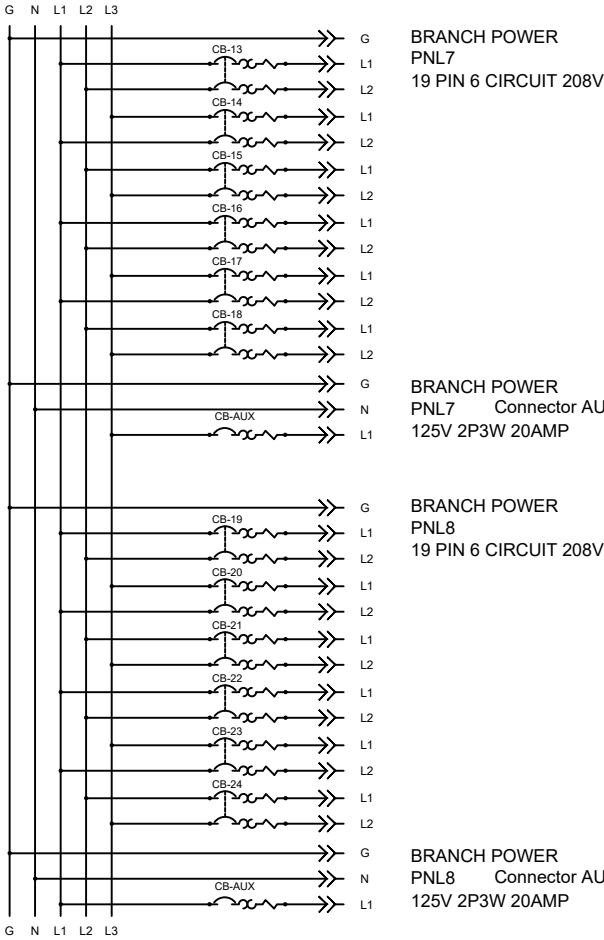

208VAC
6 CIRCUIT
20AMPS MAX

PINOUT: P19-04
1 = H CKT 1
2 = H CKT 1
3 = H CKT 2
4 = H CKT 2
5 = H CKT 3
6 = H CKT 3
7 = H CKT 4
8 = H CKT 4
9 = H CKT 5
10 = H CKT 5
11 = H CKT 6
12 = H CKT 6
13-19 = GROUND RING

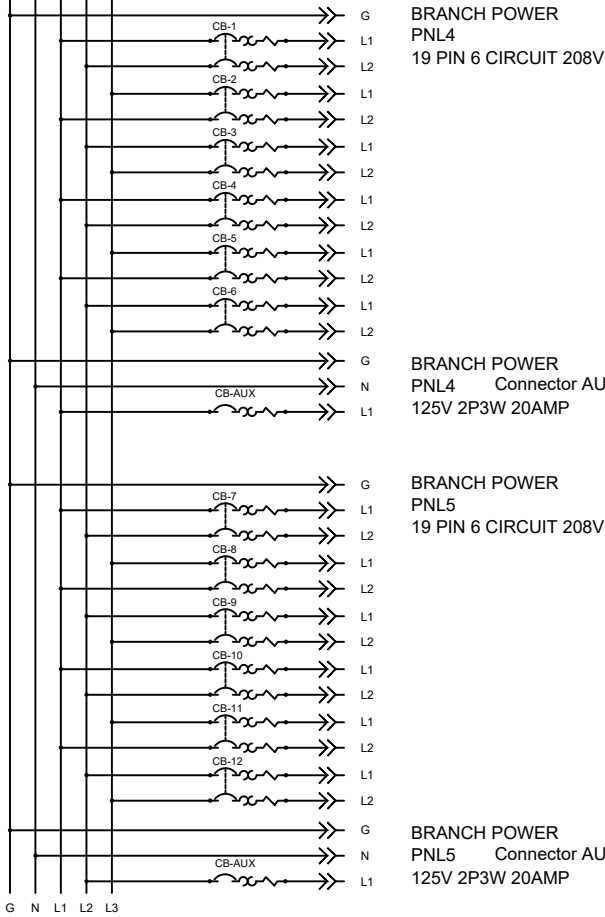

REV	DESCRIPTION	DATE	APPROVED
B	REVISED PER ECN 100, WAS 1300-BARBIZON-120513. SB 11/14/18	11/15/18	JK

motionlabs 520 Furnace Dock Road Corlandt Manor, NY 10567 Copyright © 2016 Motion Labs, Inc. All Rights Reserved. This document is the exclusive, confidential property of Motion Laboratories, Inc. and it shall not be reproduced, copied, or used for any purpose whatsoever, unless, and strictly to the extent, such is expressly authorized by Motion Laboratories, Inc. in writing.		TITLE SCHEMATIC		DRAWN BY JK	DATE DRAWN 12/11/13	SIZE D	DRAWING NUMBER 1300-400A-18-2-07	REV B
CHECKED BY JC		DATE CHECKED 12/13/13		MODEL FILENAME & PATH N:\Engineering\Schematics\Final Assembly\1300-400A-18-2-07.sch		SHEET		1 OF 1